


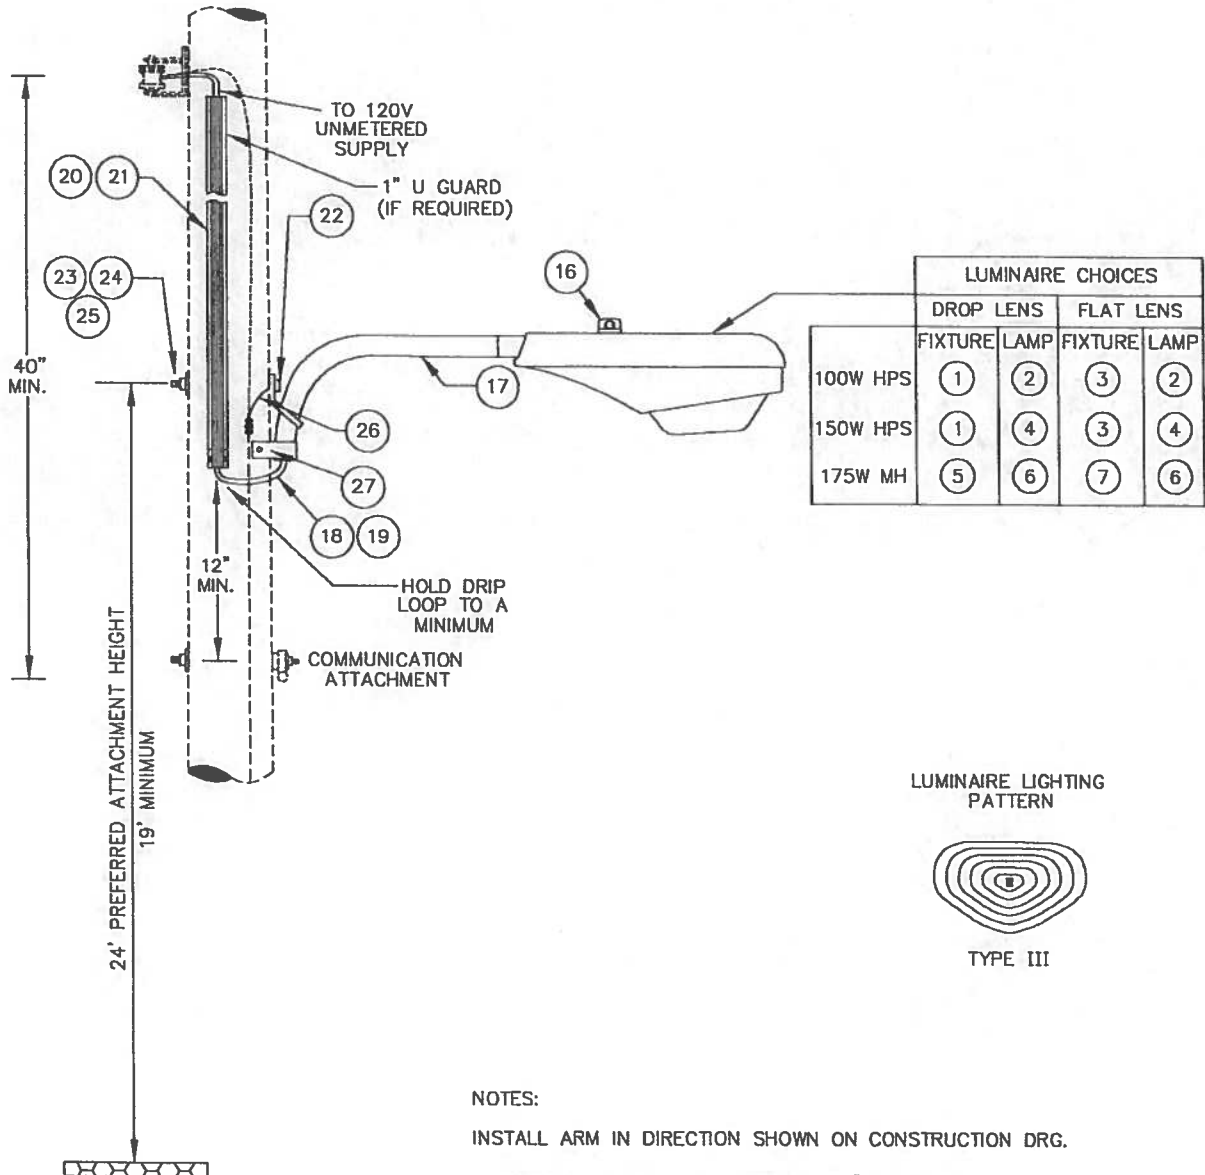

NOTES:

INSTALL ARM IN DIRECTION SHOWN ON CONSTRUCTION DRG.

A MINIMUM WORKING DISTANCE OF 30" SHALL BE
MAINTAINED FROM NEAREST ENERGIZED PRIMARY
CONDUCTOR (BELOW 22KV PHASE TO GROUND)
TO ANY PART OF THE LIGHT ASSEMBLY.