

# **KEEFE PROPERTY TRACT 2 & 3**

## ***Detention Calculations***

**LIBERTY WAY**

**WEST CHESTER TOWNSHIP, BUTLER COUNTY, OHIO**

**SEPTEMBER 13, 2016**

*PREPARED BY:*

*BAYER BECKER*

*6900 TYLERSVILLE ROAD*

*MASON, OHIO 45040*

*P (513) 336-6600*

## SUMMARY OF DATA

Method of Hydrograph Development: TR-55

Software: Autodesk Storm and Sanitary Stand Alone

### Site Stormwater Summary

See Previous Keefe  
Detention Reports

Critical Storm = 50yr

Drainage Area Descriptions	Drainage Area (Acres)	CN	Tc (Mins)	Q1 (cfs)	Q1 (Cu. Ft.)	Q10 (cfs)	Q50 (cfs)
<b>On-Site Pre-Dev Areas</b>							
Previously Detained Areas	44.88	71.0	13.80	15.70		71.24	Pg 6 123.57
		16.4 + 4.3+18.3+5.9 = 44.90 (rounding error)					
New Commercial	7.66	71.0	13.80	2.68	Pg 7 9,724	12.64	21.19
New Residential	5.23	71.0	13.80	1.83	Pg 8 6,647	8.63	14.44
<b>On-Site Post Developed to Basin</b>							
Weatherington Pointe Cabelas & Outlots	18.30	94.0	12.00	37.48		73.47	100.72
Tylers Place Blvd to Pond	4.30	90.0	12.00	7.19		15.69	22.18
Keefe Tract 2 to Basin	5.90	94.0	12.00	12.08		24.15	32.49
Weatherington Residential	16.40	74.0	13.80	8.09		30.84	52.33
					Pg 13		Pg 12
New Commercial	7.02	96.0	12.00	15.62	45,136	29.26	39.54
<b>Off-Site Areas</b>							
Golf Course	41.60	77.0	22.20	21.29		73.09	119.72
Liberty Way	6.50	90.0	11.00	10.87		23.73	33.53
<b>Bypass Areas</b>							
New Commercial	0.57	95.0	10.00	1.26	Pg 14 3,454	2.40	3.25
New Residential	5.21	81.0	12.00	5.02	Pg 15 13,889	14.41	22.23
							Pg 19 Pg 21

Allowable Release Rate=

Q1 On-Site Pre Developed +  
Q10 Previously Detained +  
Q50 Offsite

223.27 CFS

Note: CN for pre-developed conditions are based on previously developed and approved stormwater calculations for the Keefe Property. These numbers were based on a composite of B and C soils with open space in fair condition

See Page 30 for  
routed flow rates



## Storm Water Detention/Retention Summary

Date: 9/21/2016 Revised: \_\_\_\_\_  
Design By: MJL Revised: \_\_\_\_\_  
Checked By: \_\_\_\_\_ Revised: \_\_\_\_\_

Project: Keefe Tract 2 File No.: 15M053-000  
County: Butler City/Township: West Chester Twp

Basin Primary Basin	
On-Site Area	29.32 Acres
Off-Site Area	41.60 Acres
Bypass Area	5.78 Acres

Primary Basin		
Orifice	Size	Inv Elev
Spillway	60'	862.54
1	16'	860.50
1	66" ø	854.50
1	6" ø	852.50

A Event	Primary Basin						=F+G Bypass	=C+F+G Total	Allowable
	B Inflow	C Outflow	D Elev	E Storage	F Com Byp	G Res Byp			
Q <sub>1</sub>	79.90	20.05	855.40	136,285	1.27	5.09	6.36	26.41	
Q <sub>10</sub>	203.64	110.43	858.03	268,304	2.44	14.42	16.86	127.29	
Q <sub>50</sub>	296.85	178.22	859.66	353,622	3.25	22.23	25.48	203.70	223.27 Pg 30
Q <sub>100</sub>	329.42	208.15	860.11	377,912	3.56	25.11	28.67	236.82	325.08 Pg 31

Basin Existing Pond	
On-Site Area	4.30 Acres
Off-Site Area	0.00 Acres
Bypass Area	0.00 Acres

Existing Pond		
Orifice	Size	Inv Elev
T/GR	8'	867.30
Spillway	35'	866.80
3	12"X36"	865.50

A Event	B Inflow	C Outflow	D Elev	E Storage
Q <sub>1</sub>	17.85	10.73	864.98	10,583
Q <sub>10</sub>	52.24	36.79	865.67	26,321
Q <sub>50</sub>	63.93	41.16	866.25	42,017
Q <sub>100</sub>	67.81	42.67	866.53	49,766

— -



## Storm Water Detention/Retention Summary

Date: 9/9/2016 Revised: \_\_\_\_\_  
Design By: MJL Revised: \_\_\_\_\_  
Checked By: \_\_\_\_\_ Revised: \_\_\_\_\_

Project: Keefe Tract 2 File No.: 15M053-000  
County: Butler City/Township: West Chester Twp

### Basin Cabelas WQ Basin

On-Site Area      18.30 Acres  
Off-Site Area      6.50 Acres  
Bypass Area      0.00 Acres


Cabelas WQ		
Orifice	Size	Inv Elev
T/Dike		871.00
South	8'	869.17
North	16'	868.92
1	3.75" ø	866.97

A Event	B Inflow	C Outflow	D Elev	E Storage
Q <sub>1</sub>	48.15	43.28	869.72	80,402
Q <sub>10</sub>	97.12	84.16	870.48	91,769
Q <sub>50</sub>	134.06	102.19	871.41	107,120
Q <sub>100</sub>	146.85	108.61	871.84	114,387

## Previously Detained Areas

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	71.24
Storm Frequency	=	10 yrs	Time to Peak =	14:36
Time Interval	=	6 min	Hyd. Volume =	216,358 Ft <sup>3</sup>
Drainage Area	=	44.88 Acres	Curve Number =	71
Tc Method	=	User	Time of conc. (Tc) =	13.80 Mins
Total precip.	=	3.9 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

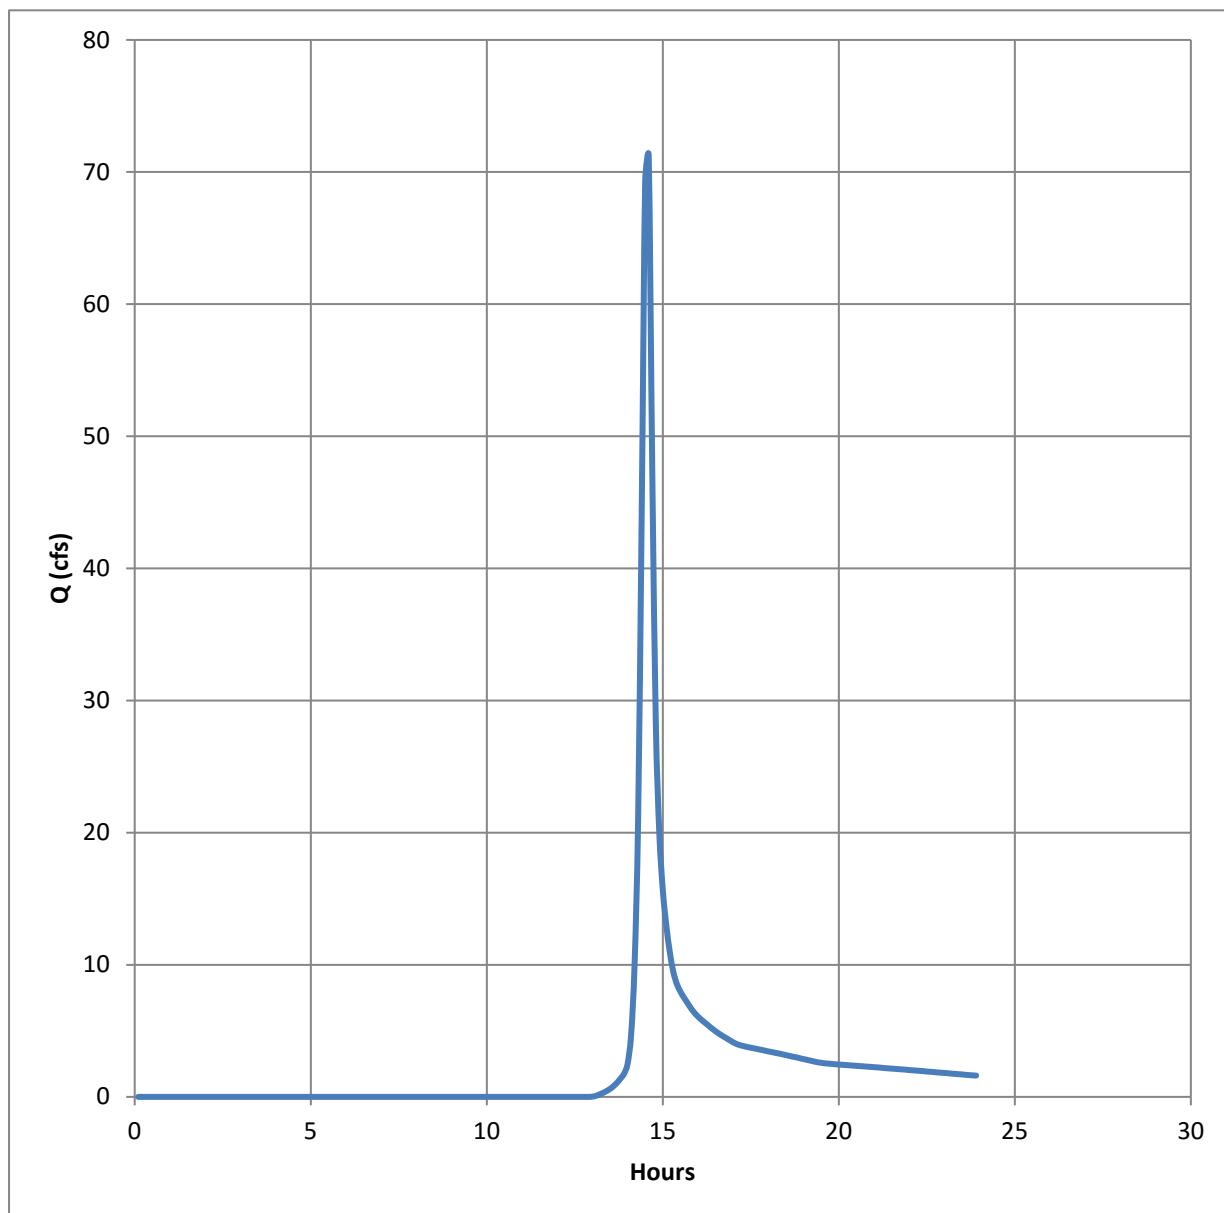

## Predeveloped Commercial Areas

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	2.68
Storm Frequency	=	1 yrs	Time to Peak =	14:36
Time Interval	=	6 min	Hyd. Volume =	9,724 Ft <sup>3</sup>
Drainage Area	=	7.66 Acres	Curve Number =	71
Tc Method	=	User	Time of conc. (Tc) =	13.80 Mins
Total precip.	=	2.4 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

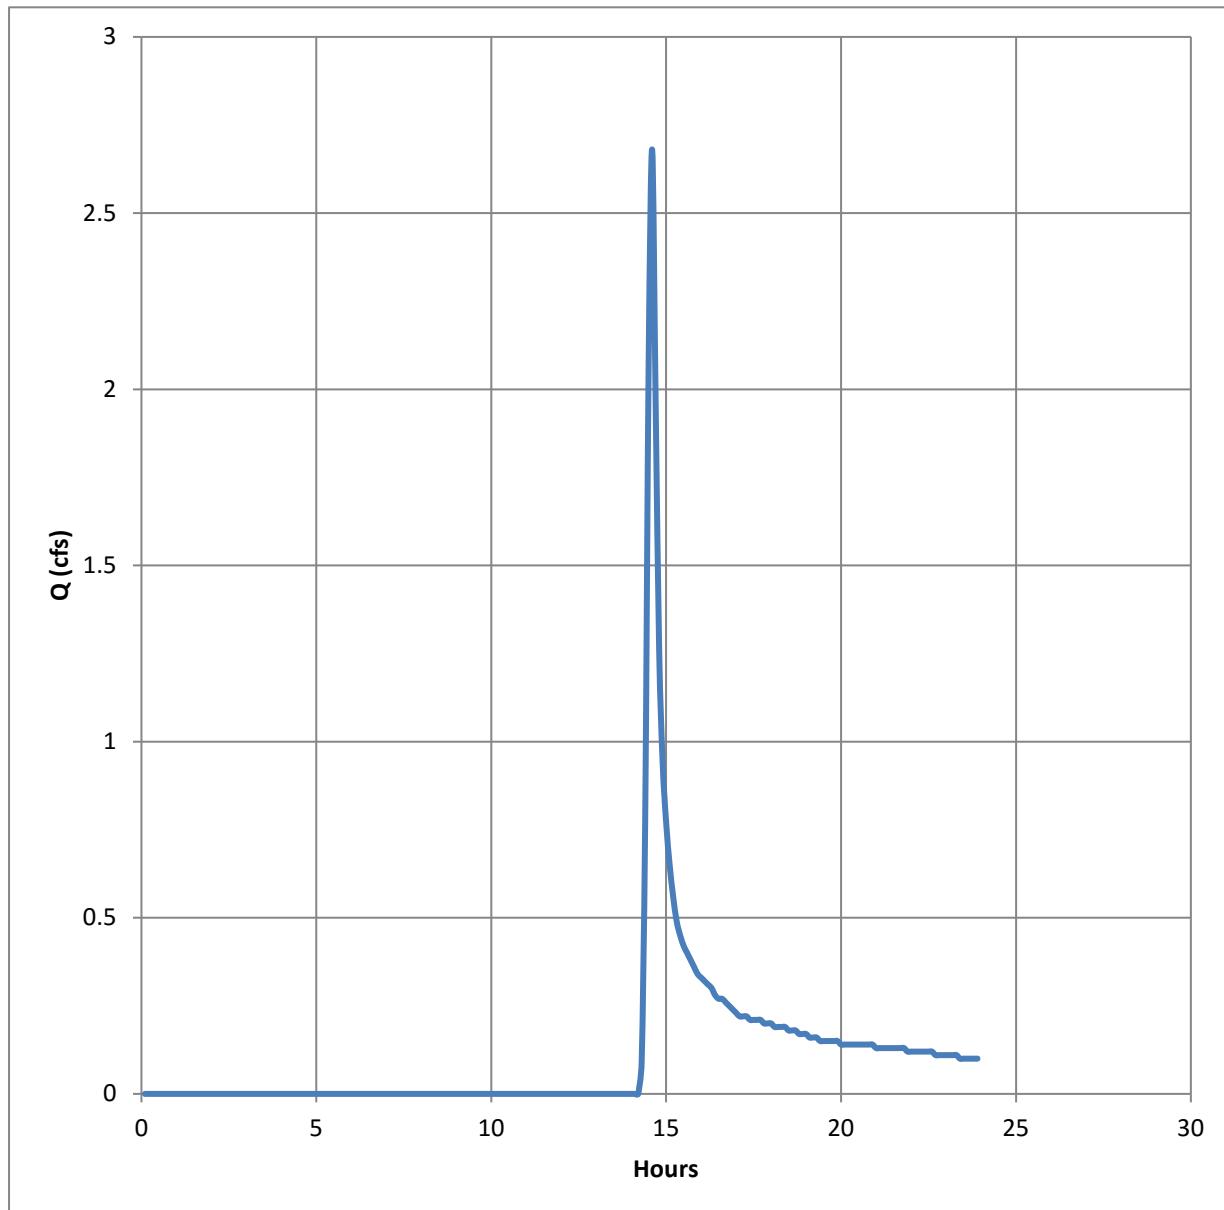

## Predeveloped Residential Area

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	1.83
Storm Frequency	=	1 yrs	Time to Peak =	14:36
Time Interval	=	6 min	Hyd. Volume =	6,647 Ft <sup>3</sup>
Drainage Area	=	5.23 Acres	Curve Number =	71
Tc Method	=	User	Time of conc. (Tc) =	13.80 Mins
Total precip.	=	2.4 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

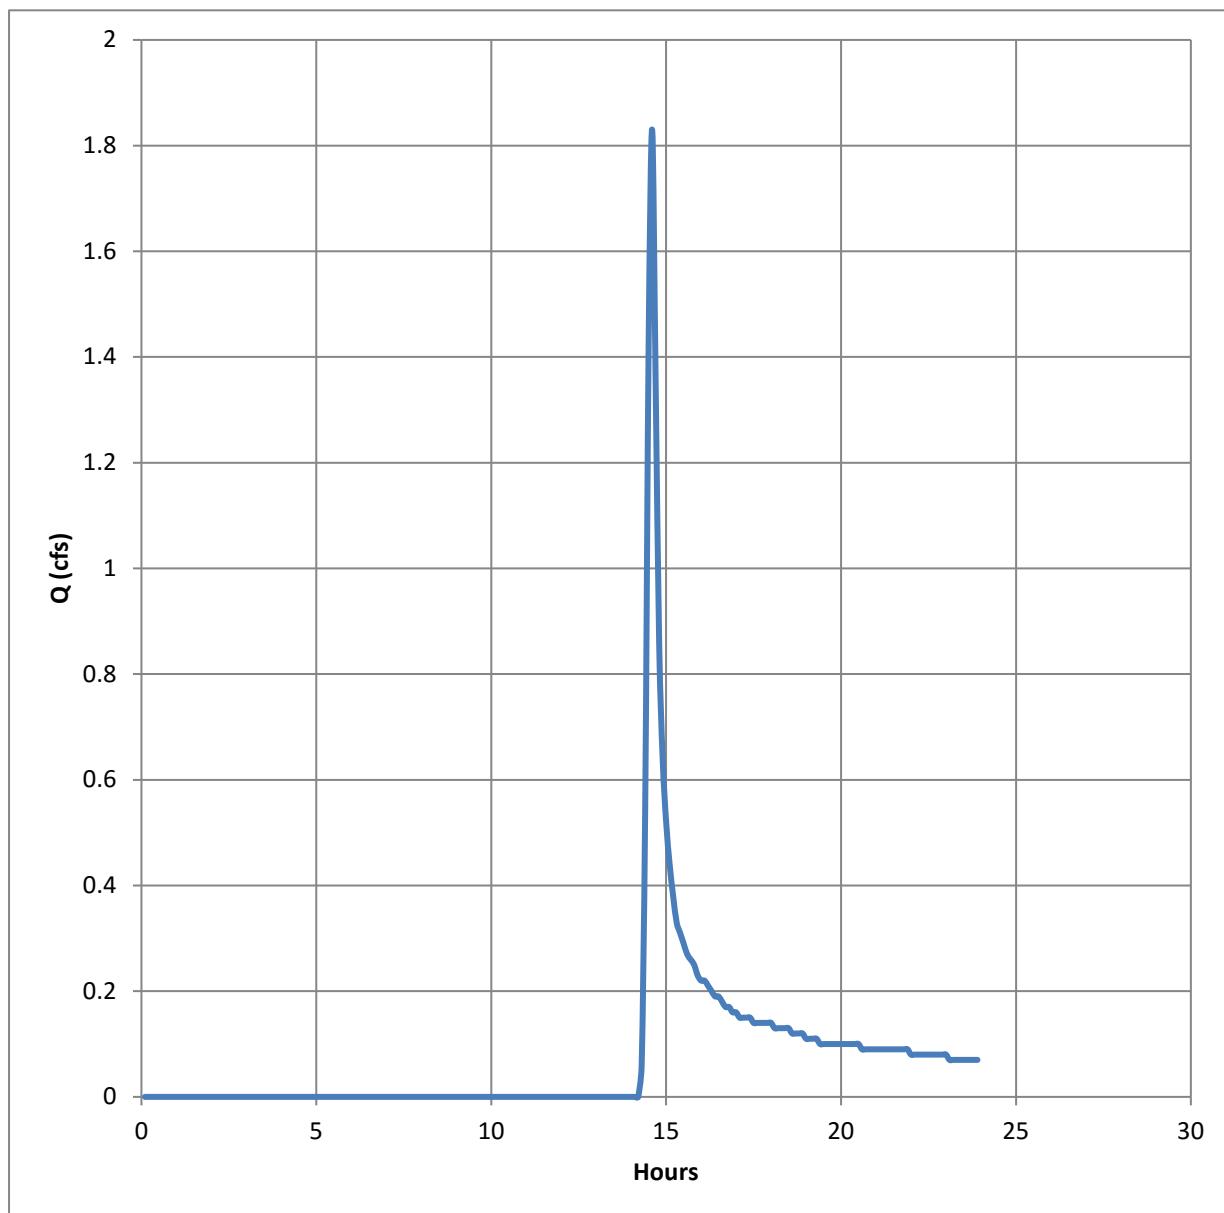

## Weatherington Pointe Cabelas & Outlots

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	100.72
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	299,066 Ft <sup>3</sup>
Drainage Area	=	18.30 Acres	Curve Number =	94
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.2 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

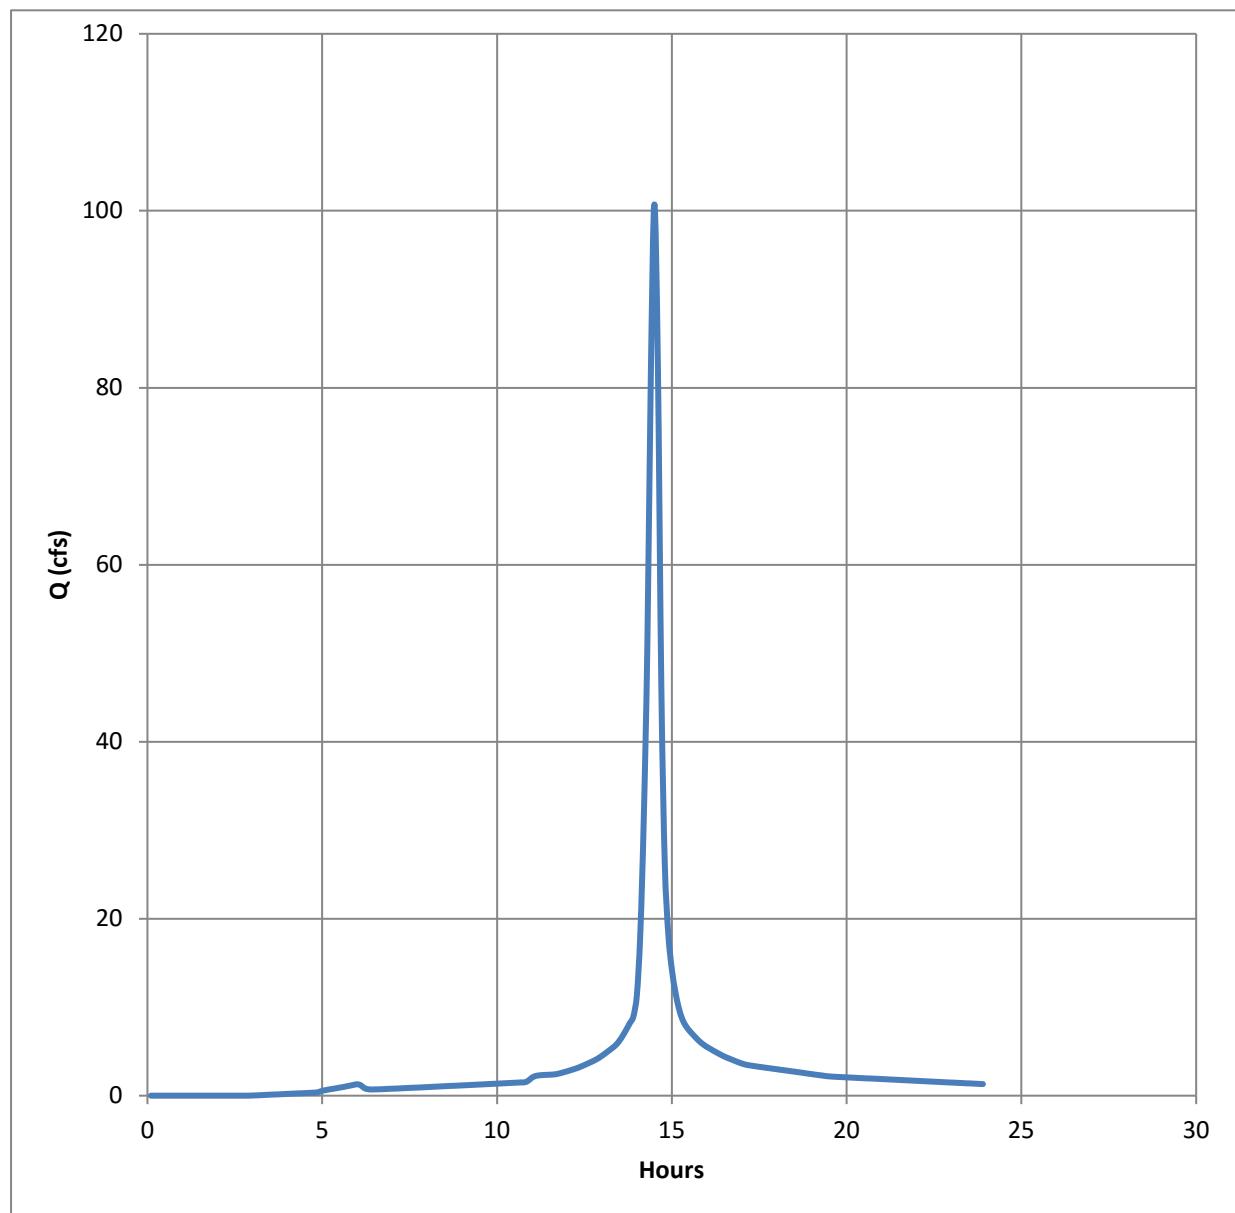

## Tylers Place Blvd to Pond

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	22.18
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	63,568 Ft <sup>3</sup>
Drainage Area	=	4.30 Acres	Curve Number =	90
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.2 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

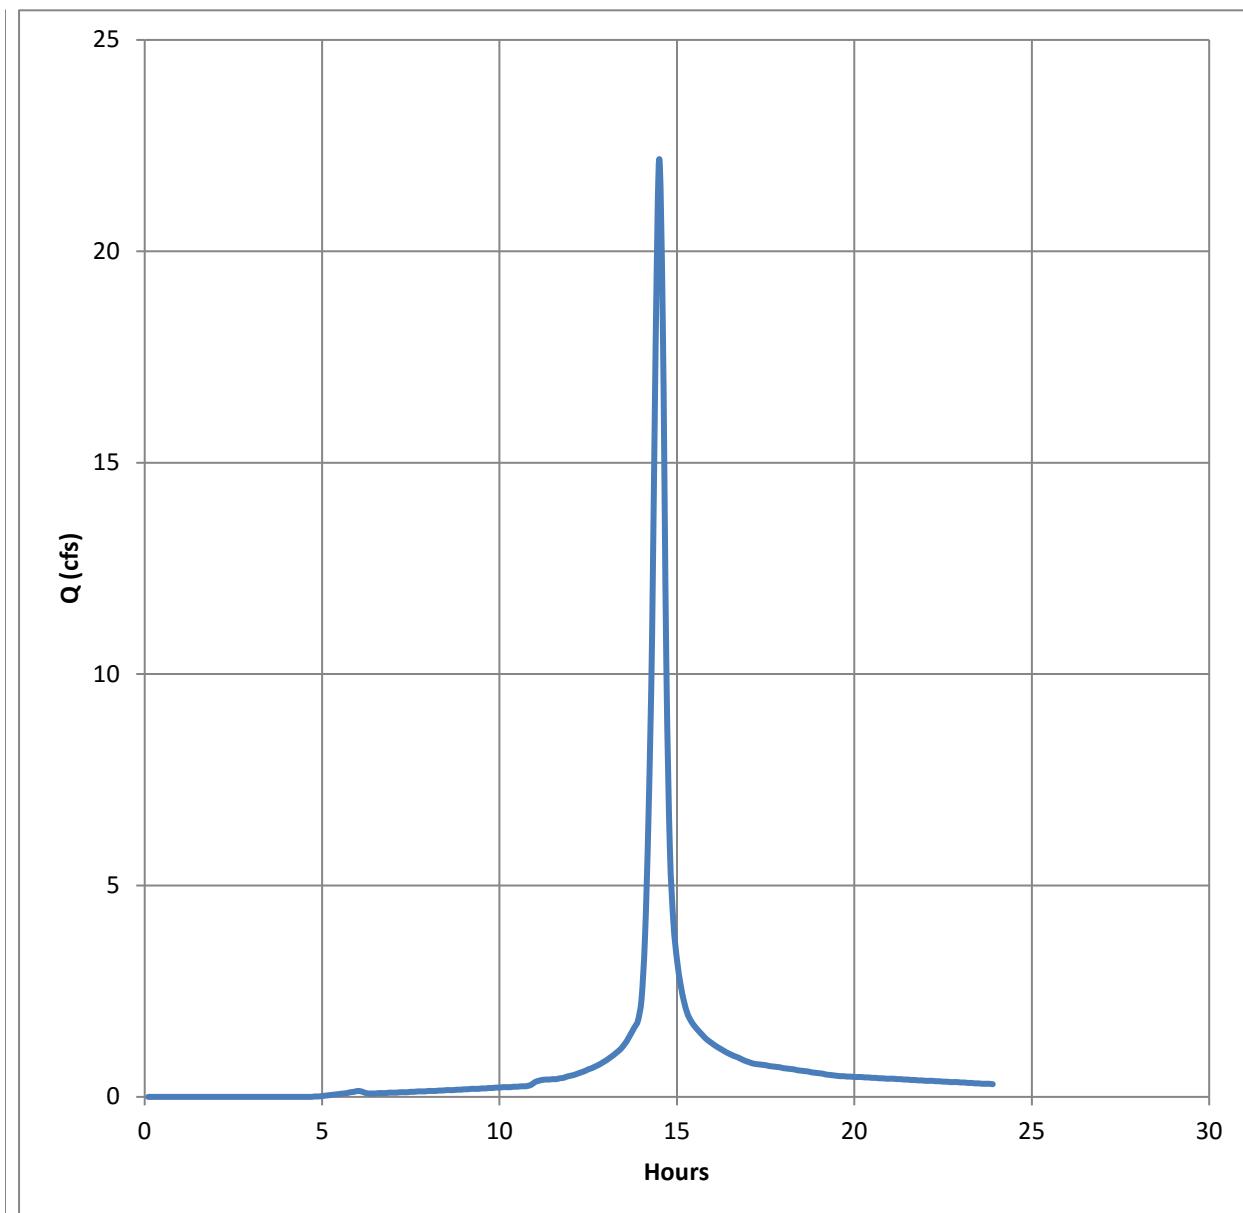

## Keefe Tract 2 to Basin

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	32.49
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	96,465 Ft <sup>3</sup>
Drainage Area	=	5.90 Acres	Curve Number =	94
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.2 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

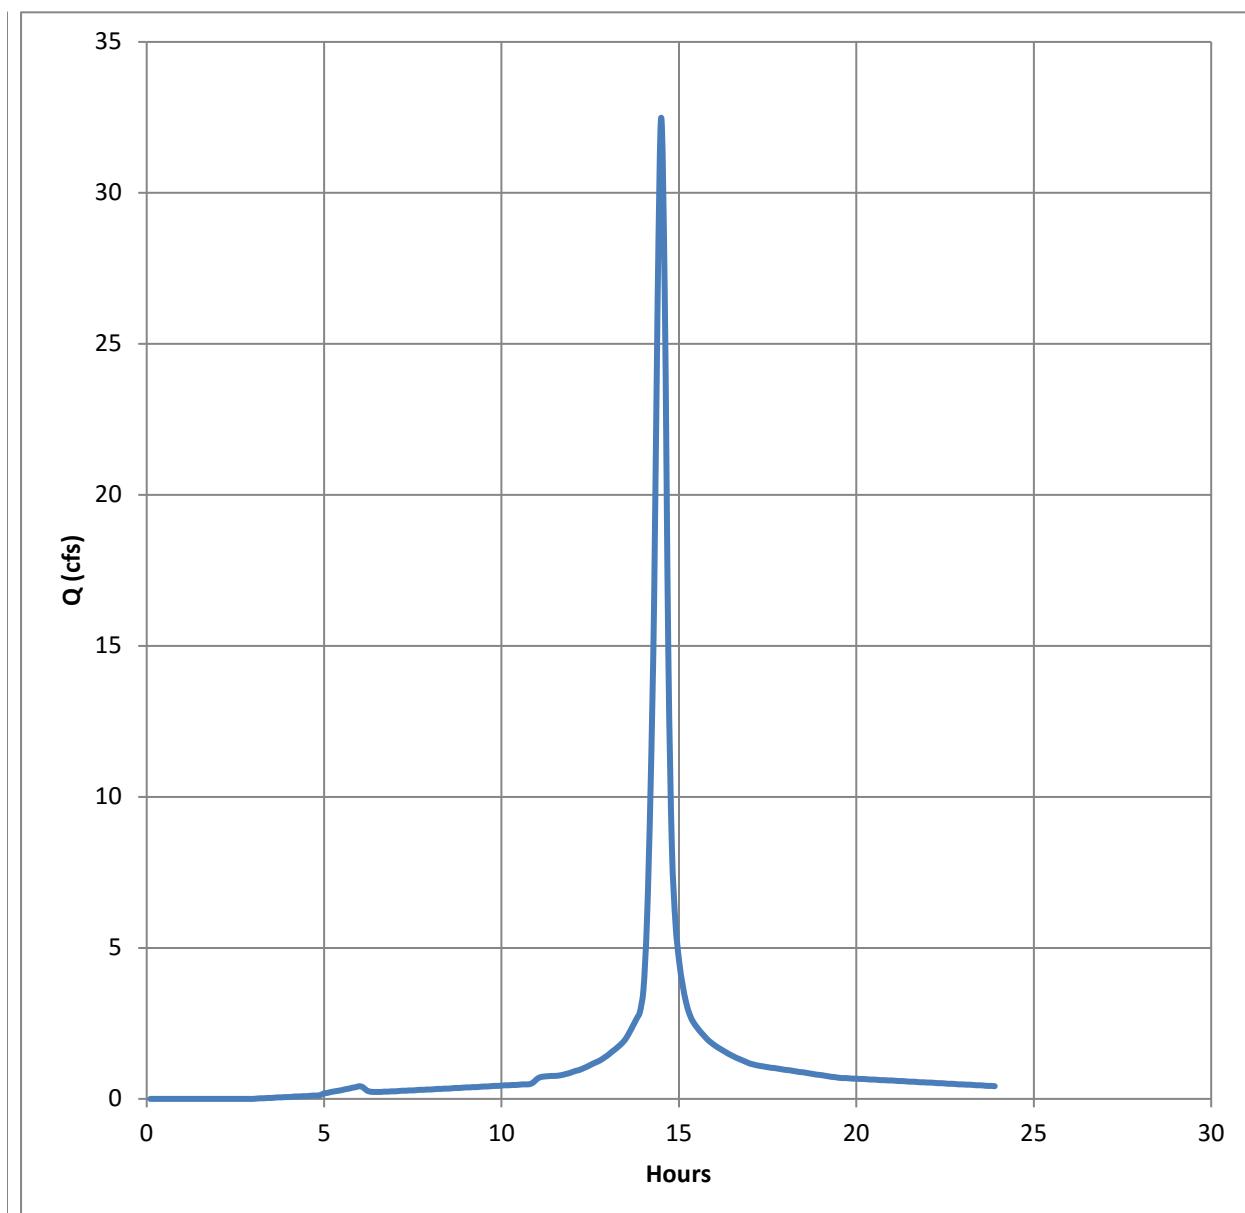

## Weatherington Residential

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	52.33
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	150,217 Ft <sup>3</sup>
Drainage Area	=	16.40 Acres	Curve Number =	74
Tc Method	=	User	Time of conc. (Tc) =	13.80 Mins
Total precip.	=	5.2 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

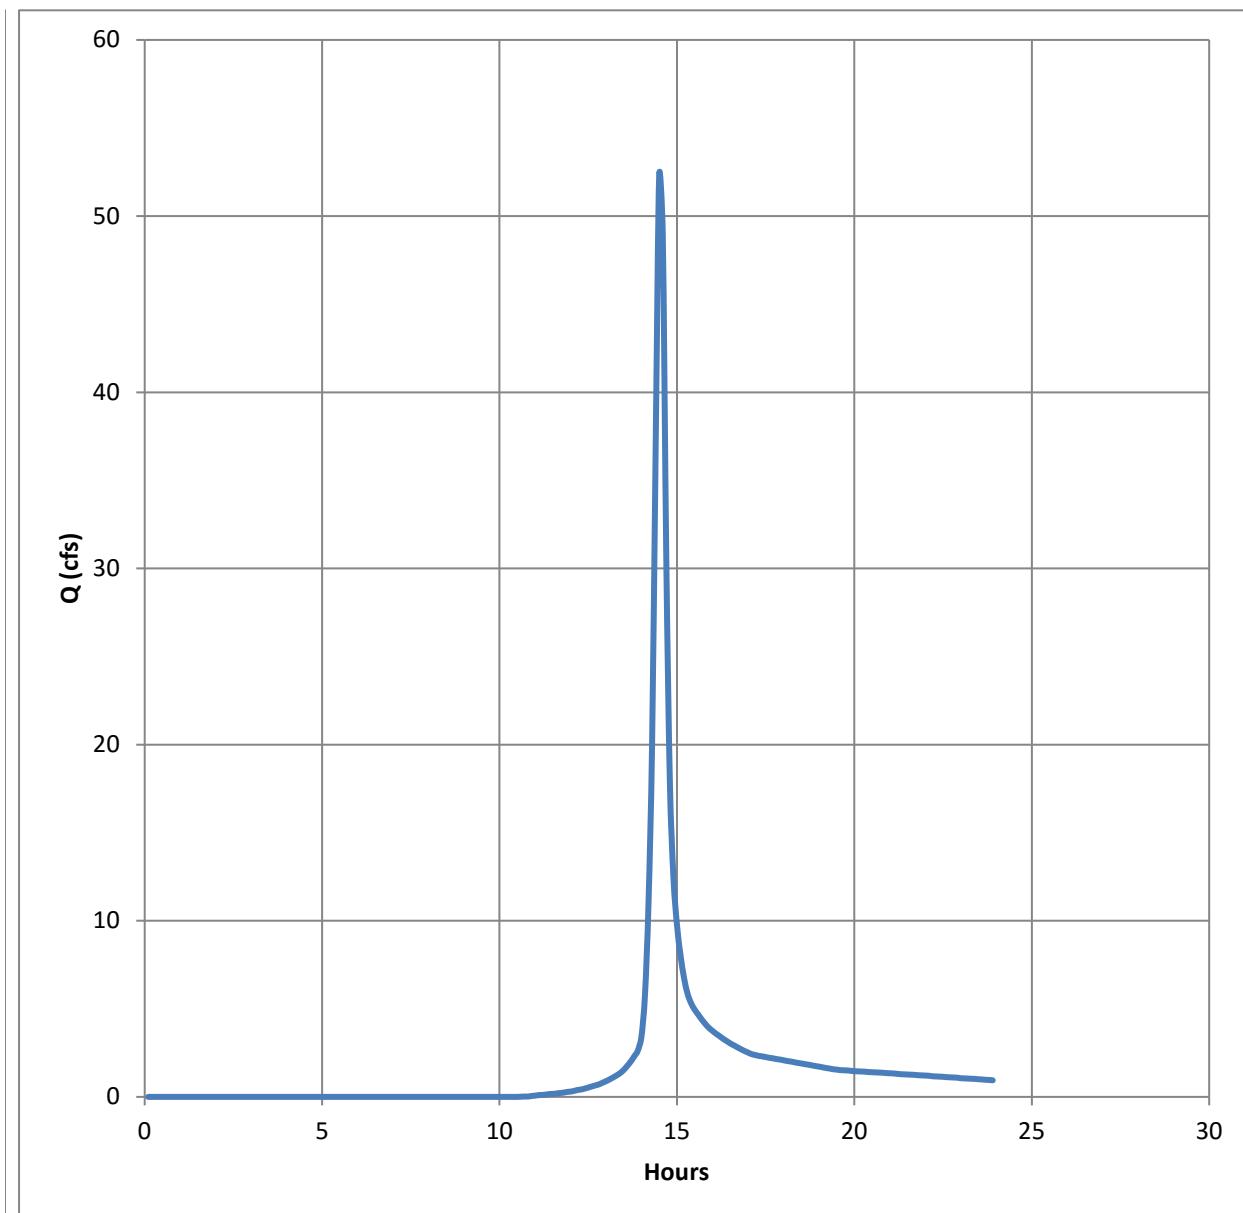

## Postdeveloped New Commerical to Basin

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	15.62
Storm Frequency	=	1 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	45,136 Ft <sup>3</sup>
Drainage Area	=	6.86 Acres	Curve Number =	96
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	2.4 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

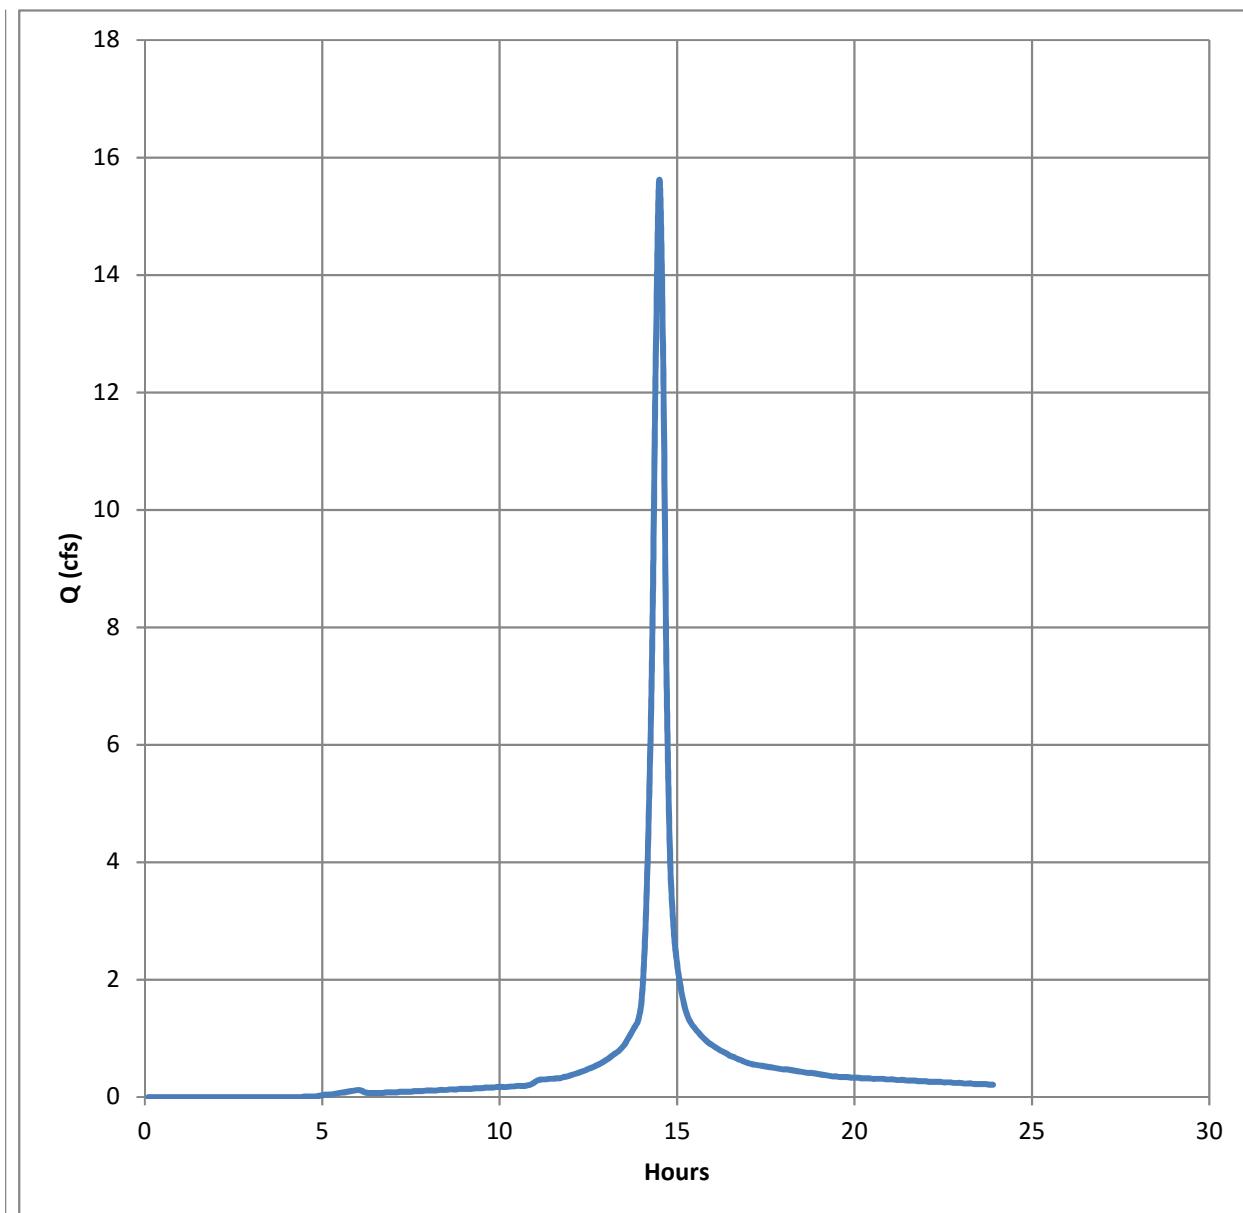

## Postdeveloped New Commercial to Bypass

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	1.26
Storm Frequency	=	1 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	3.454 Ft <sup>3</sup>
Drainage Area	=	0.80 Acres	Curve Number =	95
Tc Method	=	User	Time of conc. (Tc) =	10.00 Mins
Total precip.	=	2.4 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

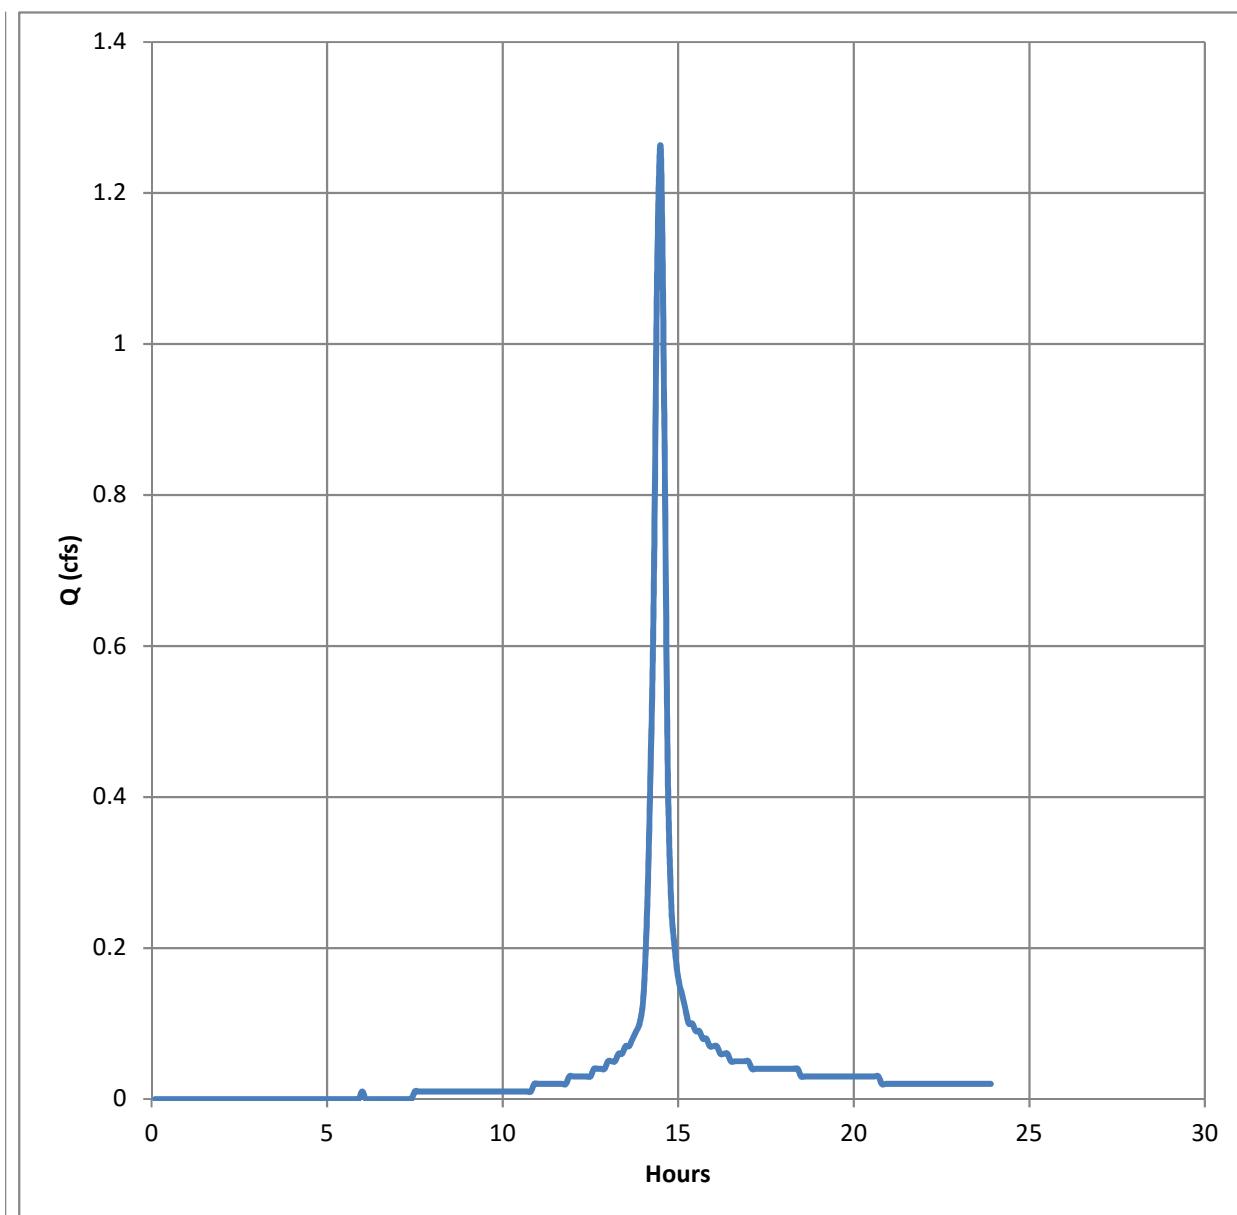

## Postdeveloped New Residential

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	5.02
Storm Frequency	=	1 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	13,889 Ft <sup>3</sup>
Drainage Area	=	5.23 Acres	Curve Number =	81
Tc Method	=	User	Time of conc. (Tc) =	10.00 Mins
Total precip.	=	2.4 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

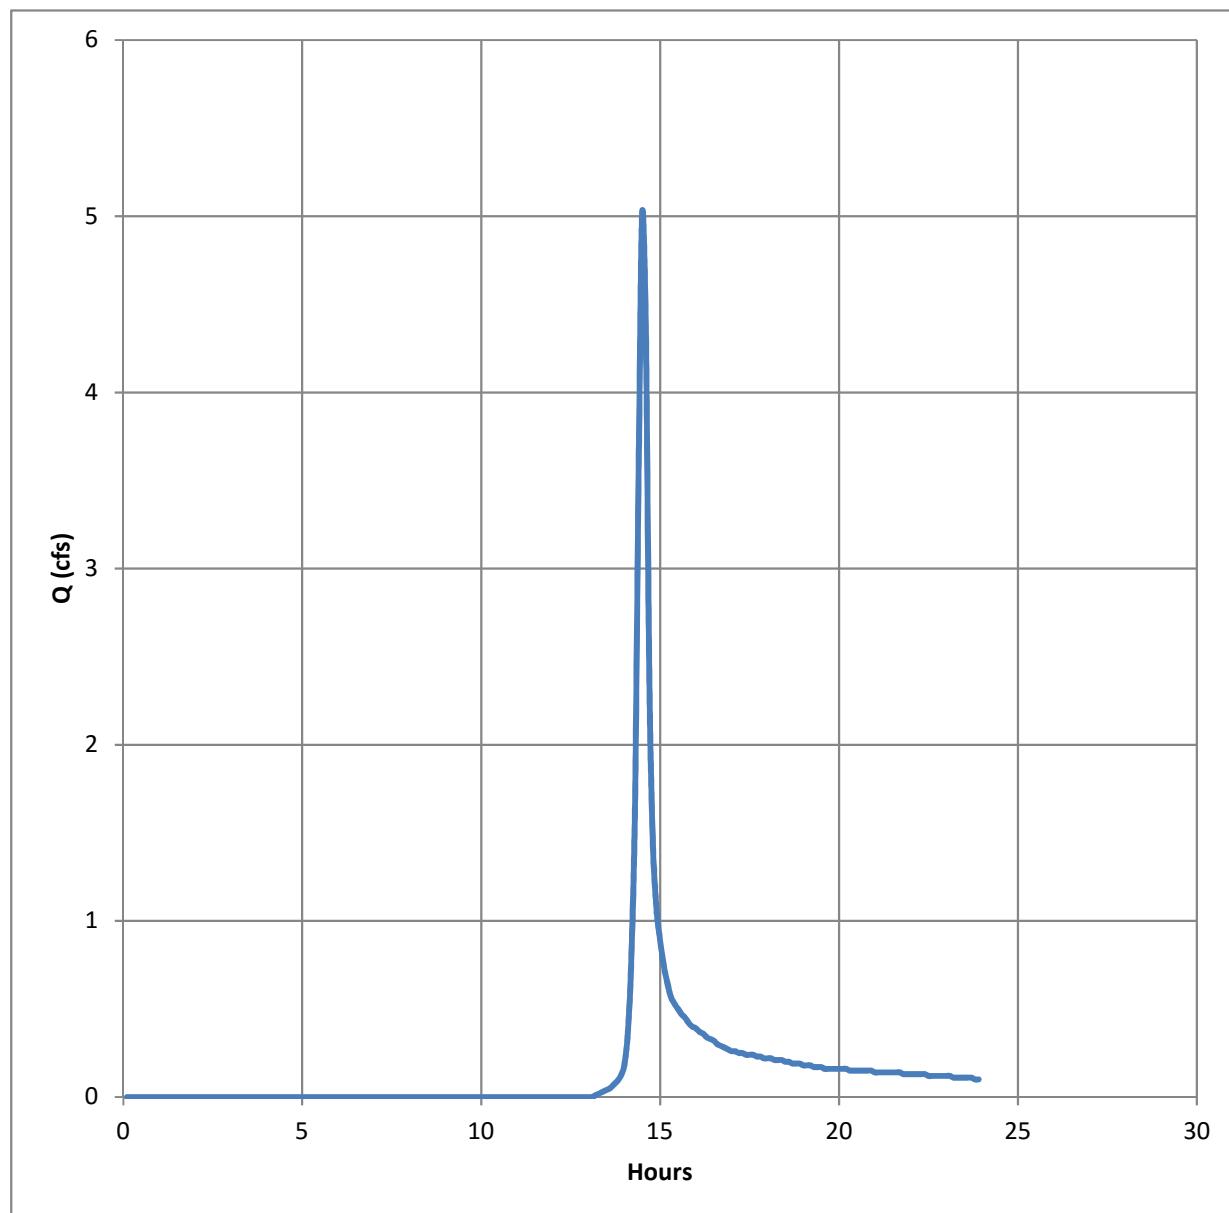

## Liberty Way Off-Site

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	33.53
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	96,034 Ft <sup>3</sup>
Drainage Area	=	6.50 Acres	Curve Number =	90
Tc Method	=	User	Time of conc. (Tc) =	11.00 Mins
Total precip.	=	5.20 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

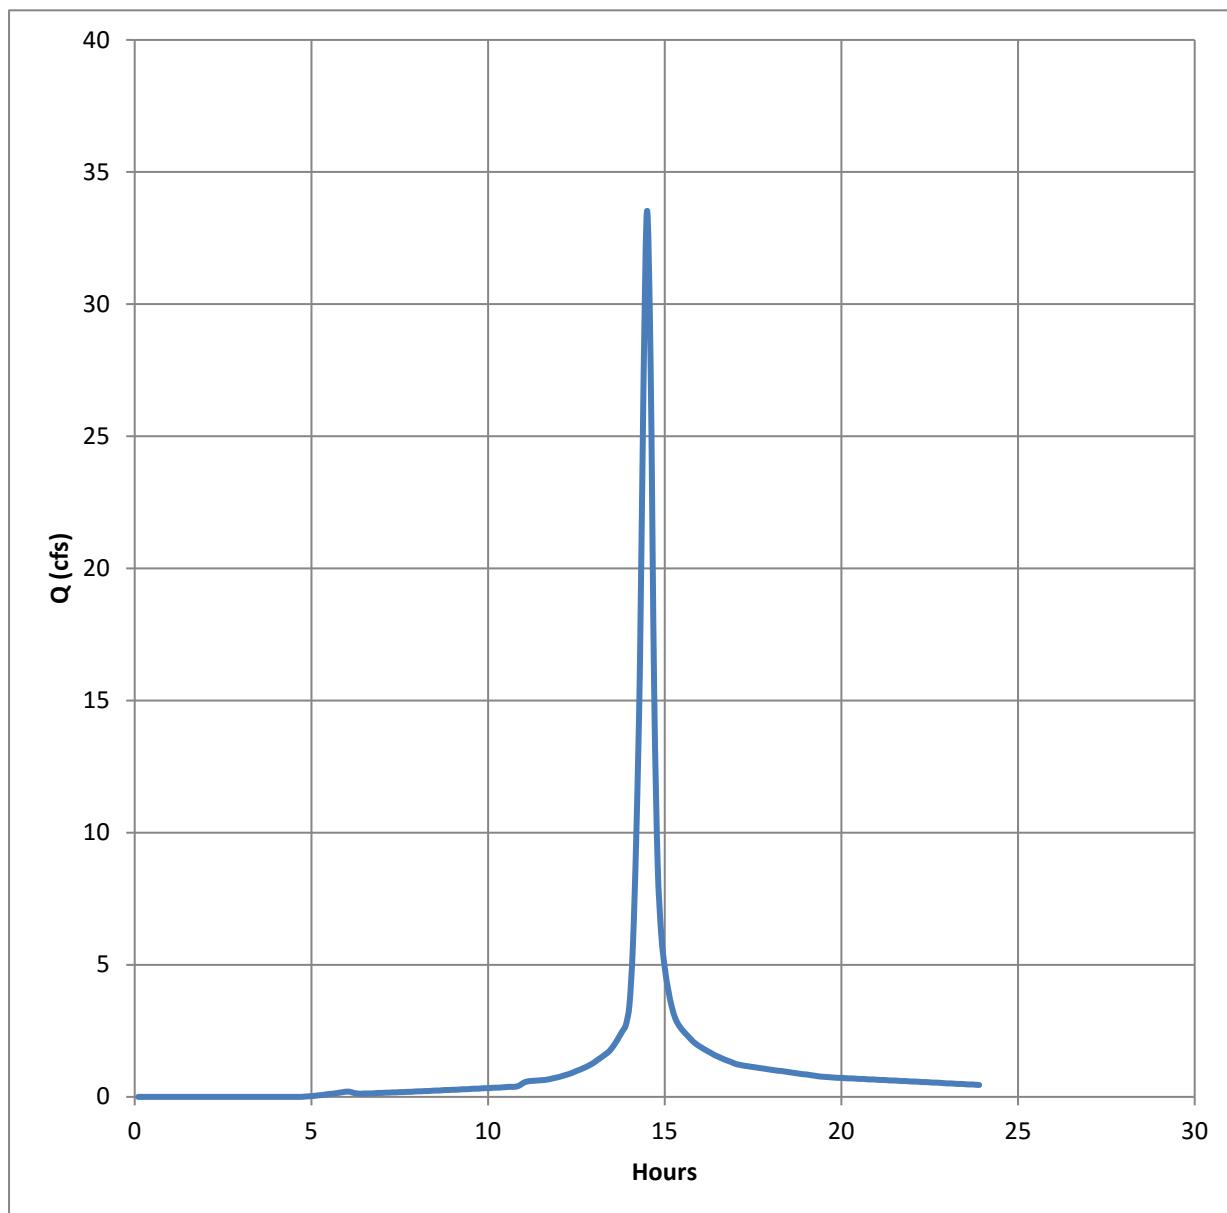

## Golf Course - Off Site

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	119.72
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	421,422 Ft <sup>3</sup>
Drainage Area	=	41.60 Acres	Curve Number =	77
Tc Method	=	User	Time of conc. (Tc) =	22.20 Mins
Total precip.	=	5.2 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

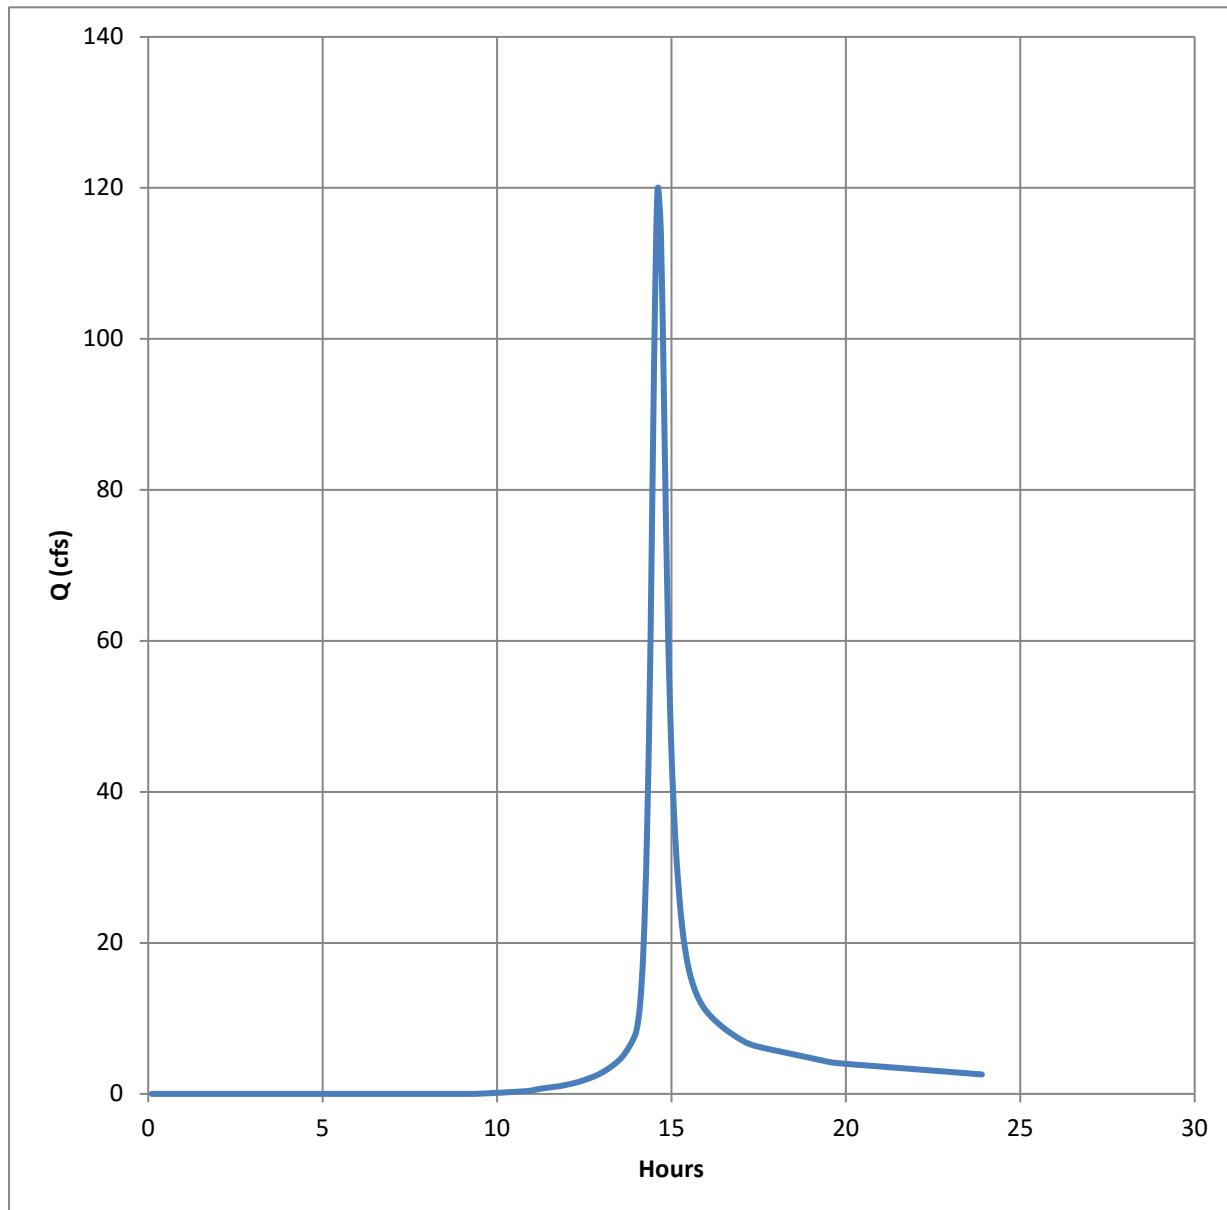

## Postdeveloped New Commercial

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	39.54
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	120,512 Ft <sup>3</sup>
Drainage Area	=	6.86 Acres	Curve Number =	96
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.2 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

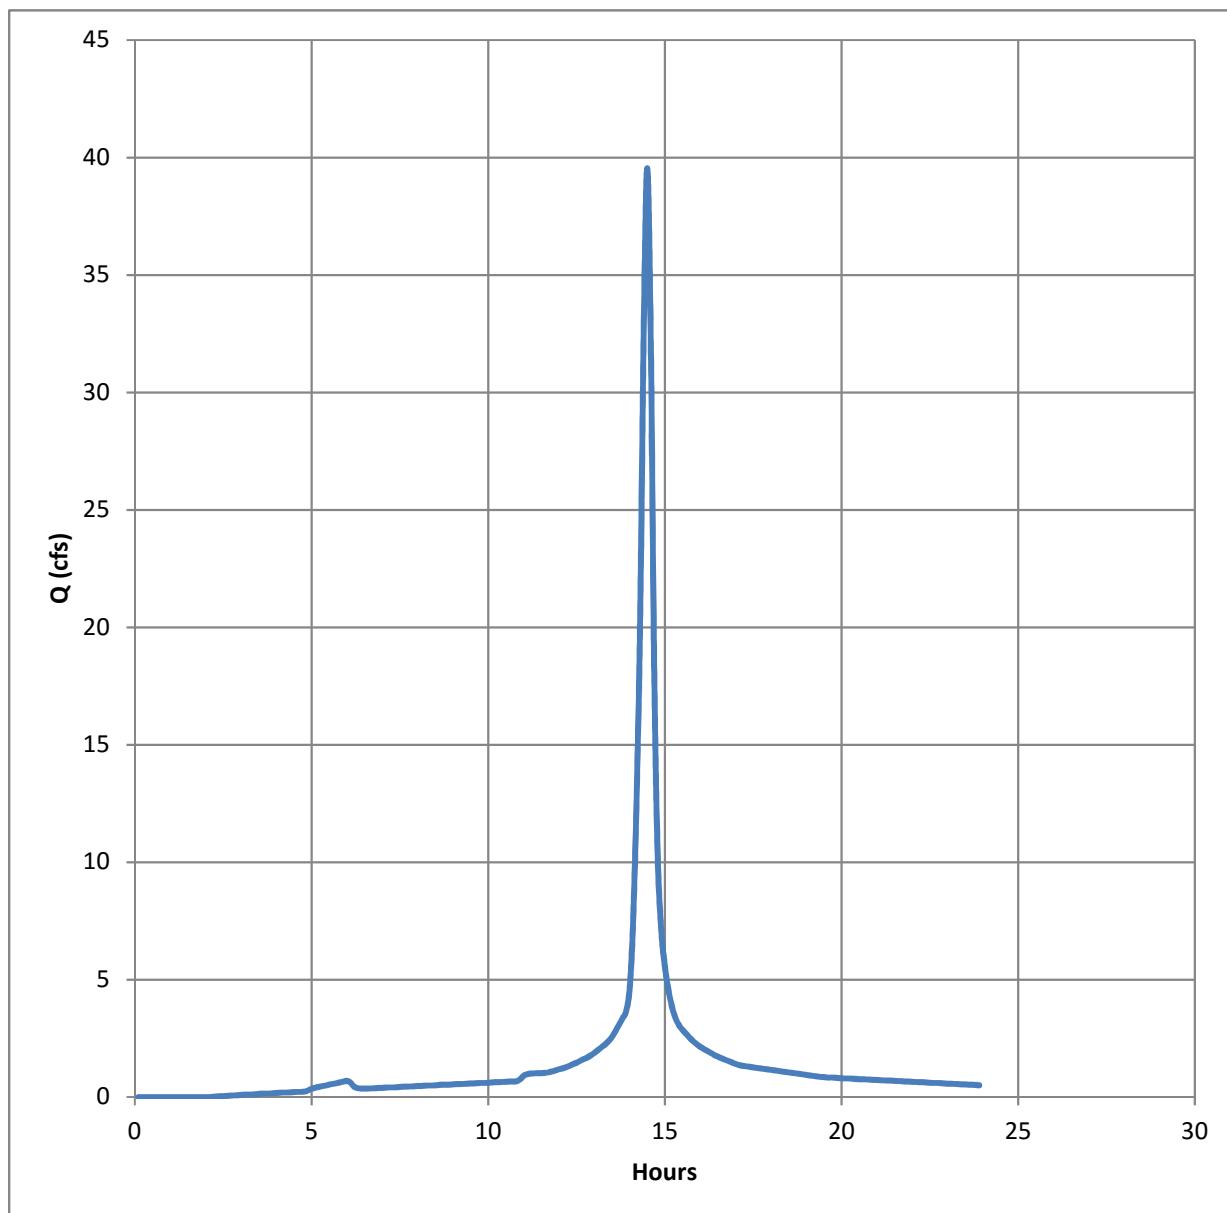

## Postdeveloped New Commercial to Bypass

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	3.25
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	9,544 Ft <sup>3</sup>
Drainage Area	=	0.80 Acres	Curve Number =	95
Tc Method	=	User	Time of conc. (Tc) =	10.00 Mins
Total precip.	=	5.2 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

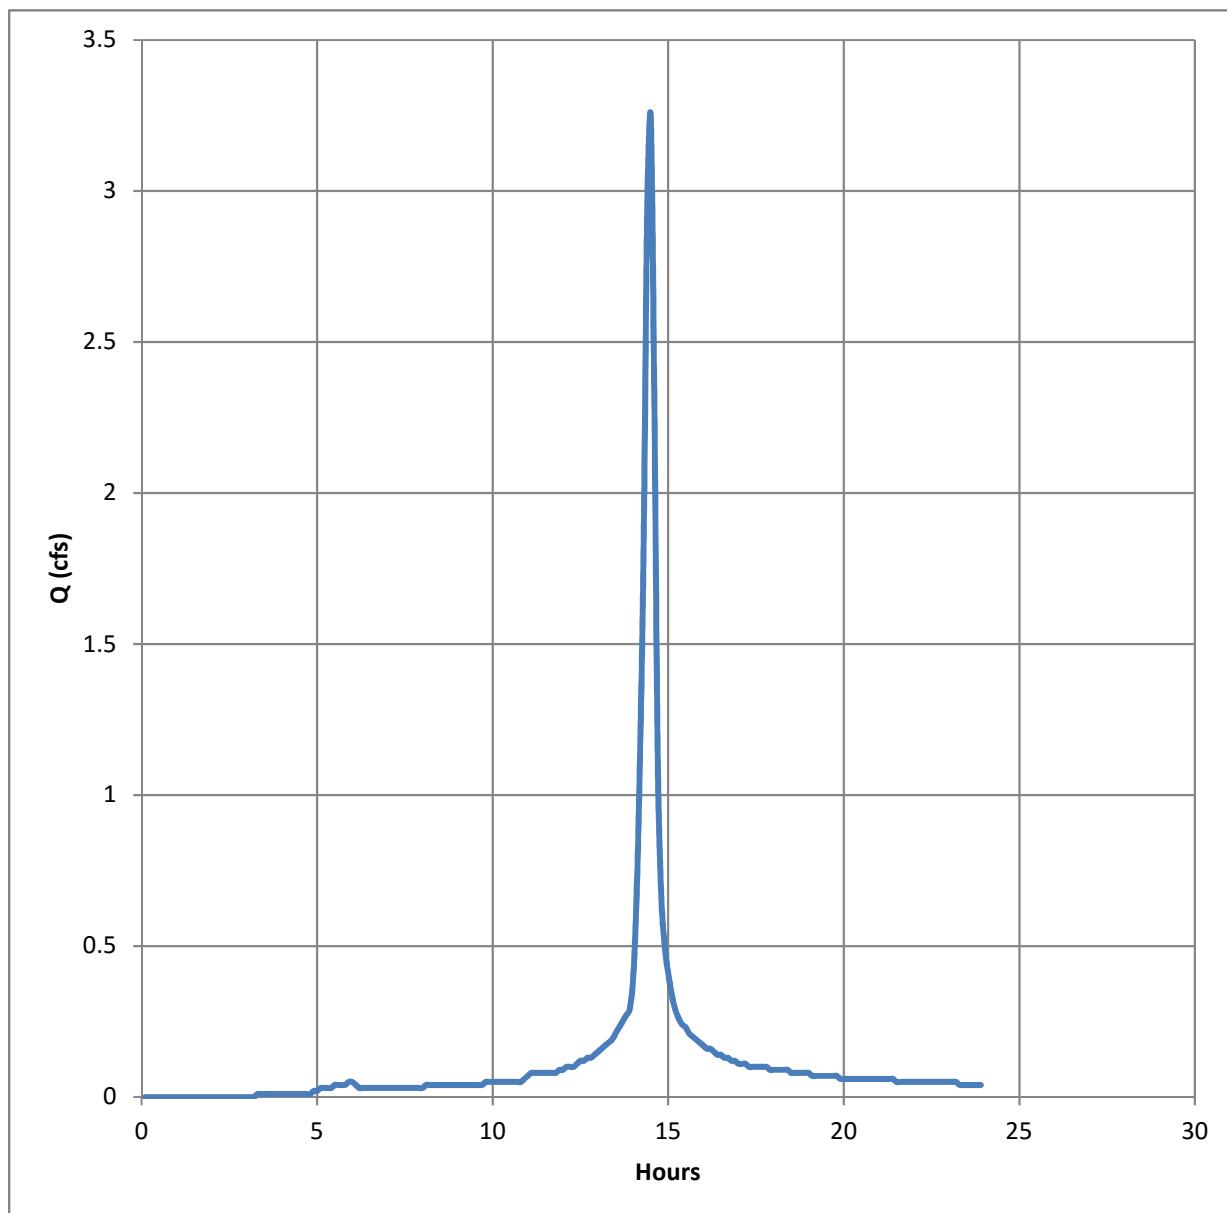

## Postdeveloped New Residential

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	22.23
Storm Frequency	=	50 yrs	Time to Peak =	14:30
Time Interval	=	6 min	Hyd. Volume =	59,816 Ft <sup>3</sup>
Drainage Area	=	5.23 Acres	Curve Number =	81
Tc Method	=	User	Time of conc. (Tc) =	11.00 Mins
Total precip.	=	5.2 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

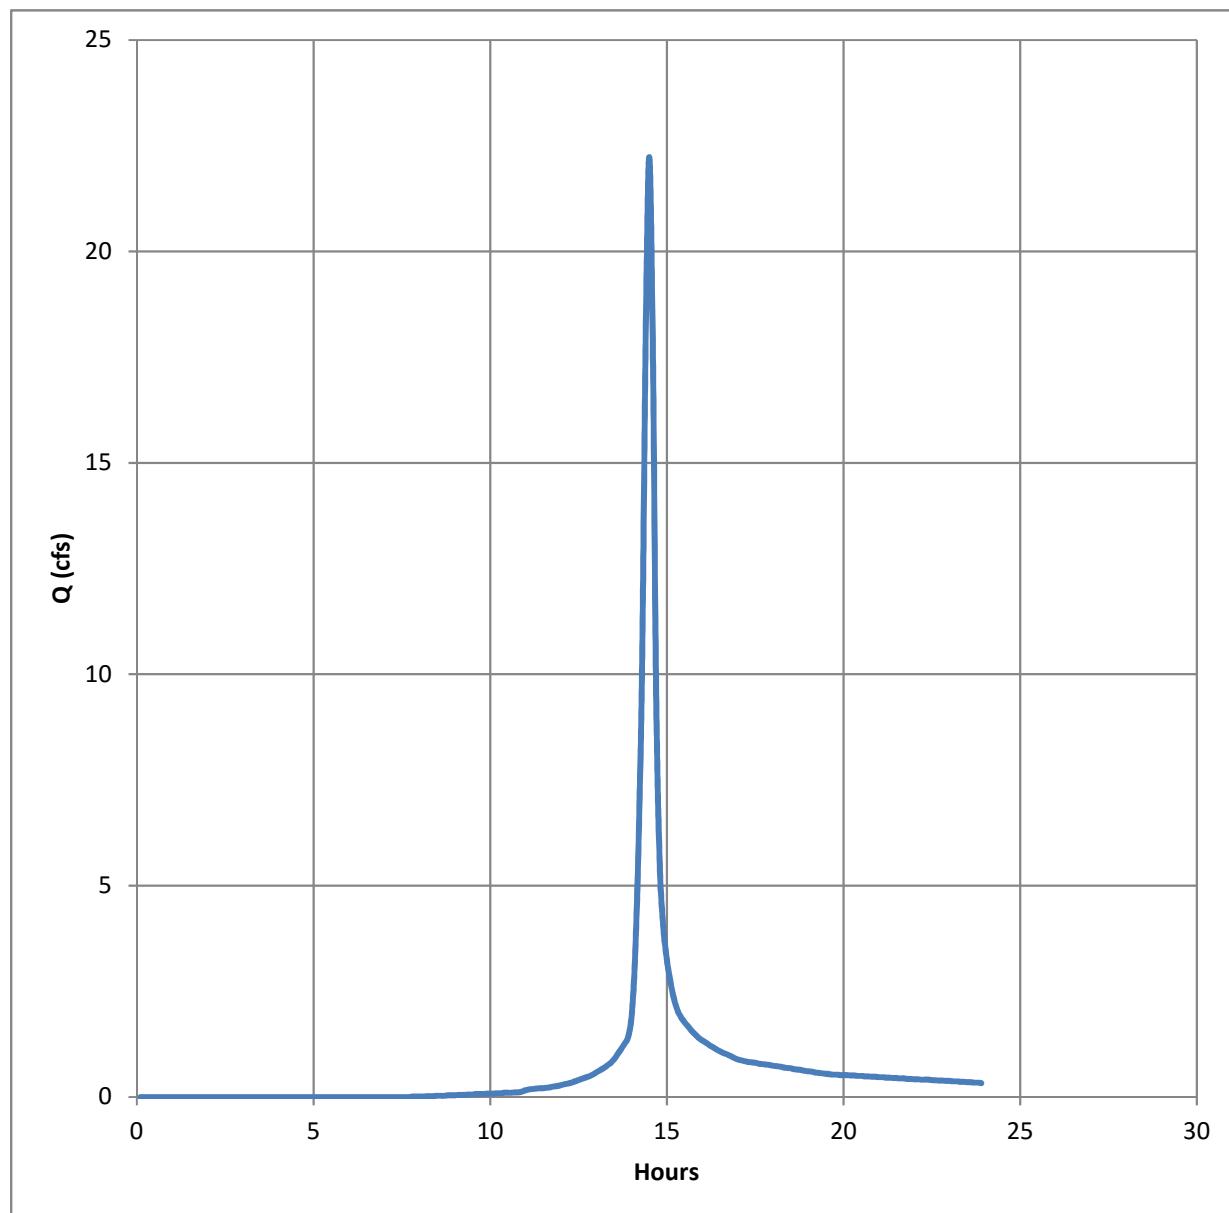

## Weatherington Pointe Cabelas and Outlots

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	110.43
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	329,991 Ft <sup>3</sup>
Drainage Area	=	18.30 Acres	Curve Number =	94
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.67 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

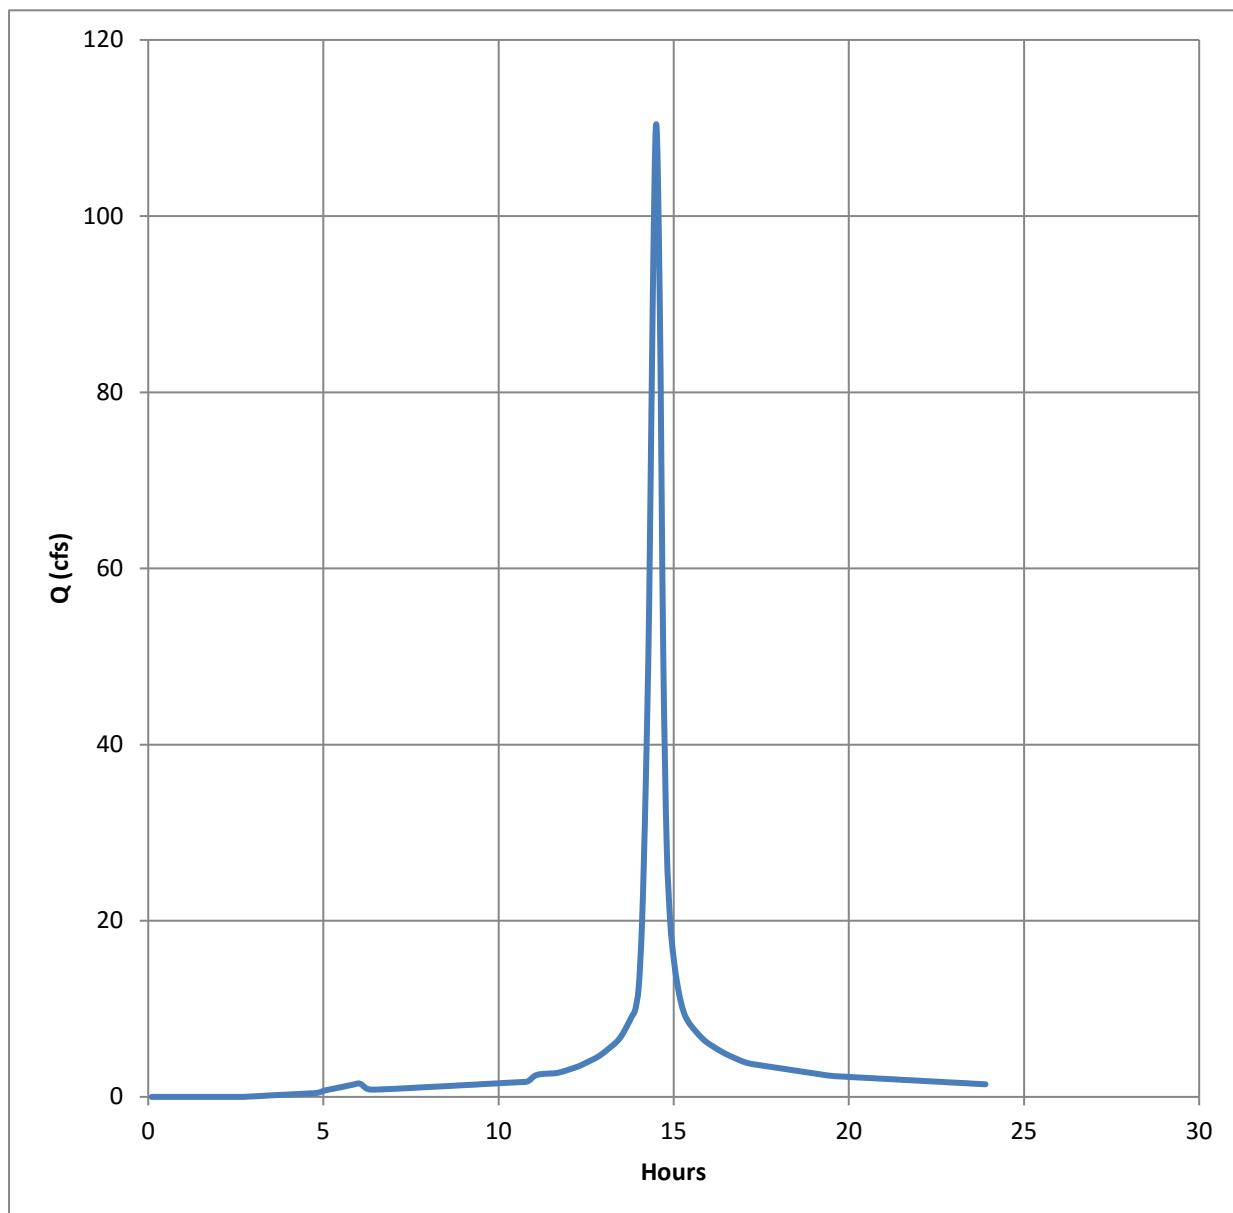

## Tylers Place Blvd to Pond

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	24.52
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	70,708 Ft <sup>3</sup>
Drainage Area	=	4.30 Acres	Curve Number =	90
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.67 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

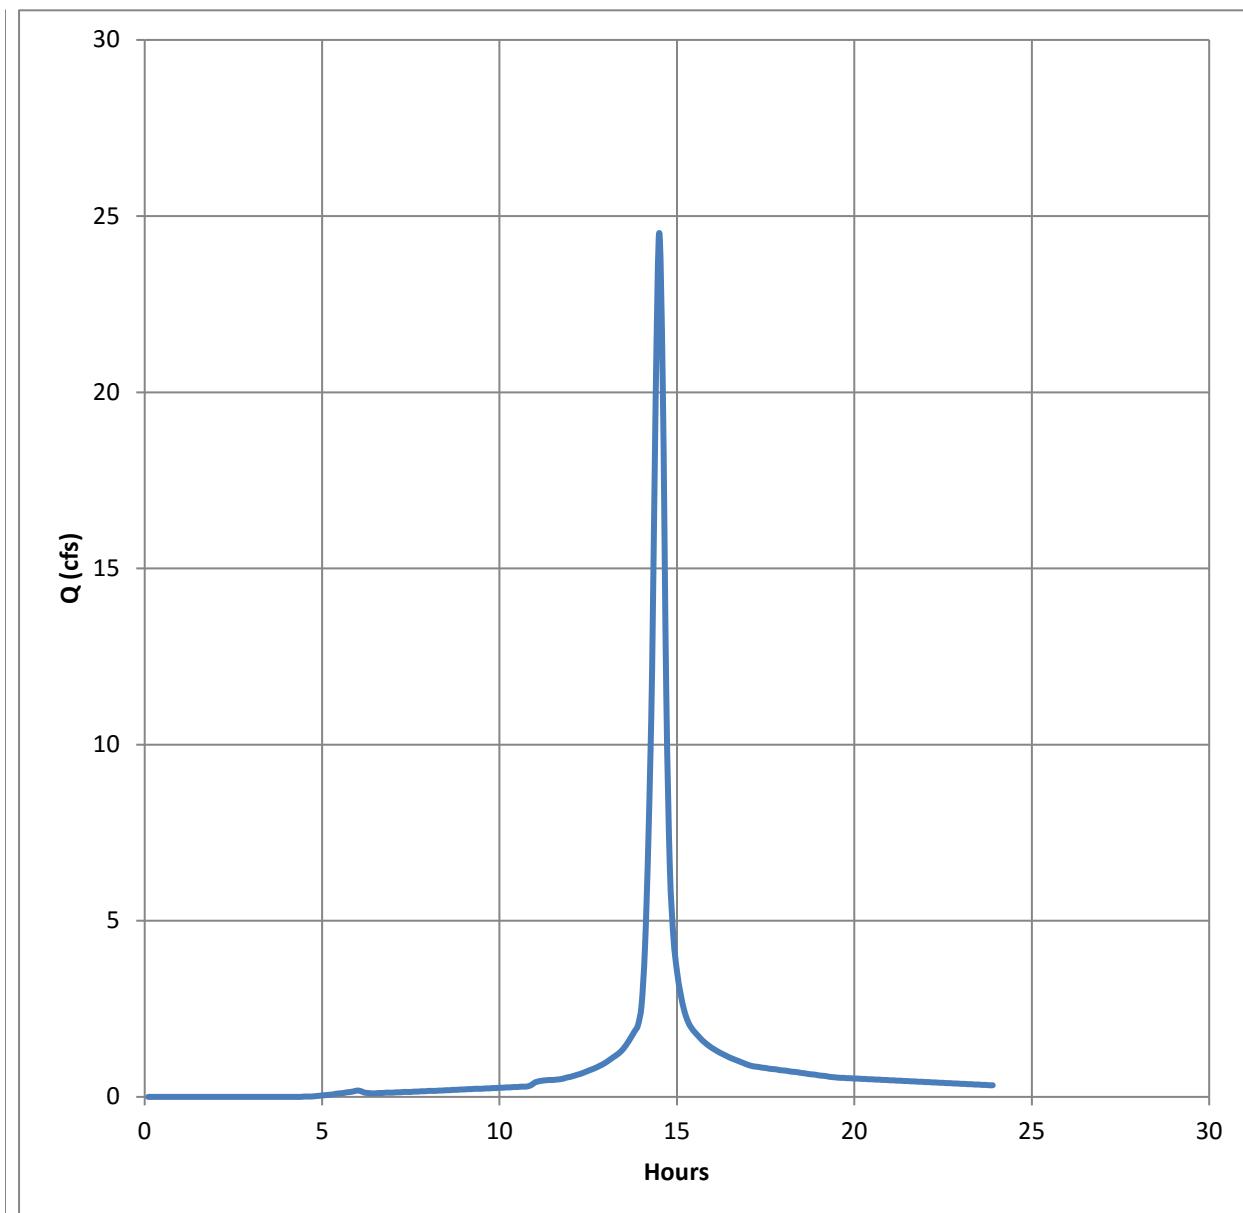

## Keefe Tract 2 to Basin

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	35.6
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	106,363 Ft <sup>3</sup>
Drainage Area	=	5.90 Acres	Curve Number =	94
Tc Method	=	User	Time of conc. (Tc) =	12.00 Mins
Total precip.	=	5.67 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

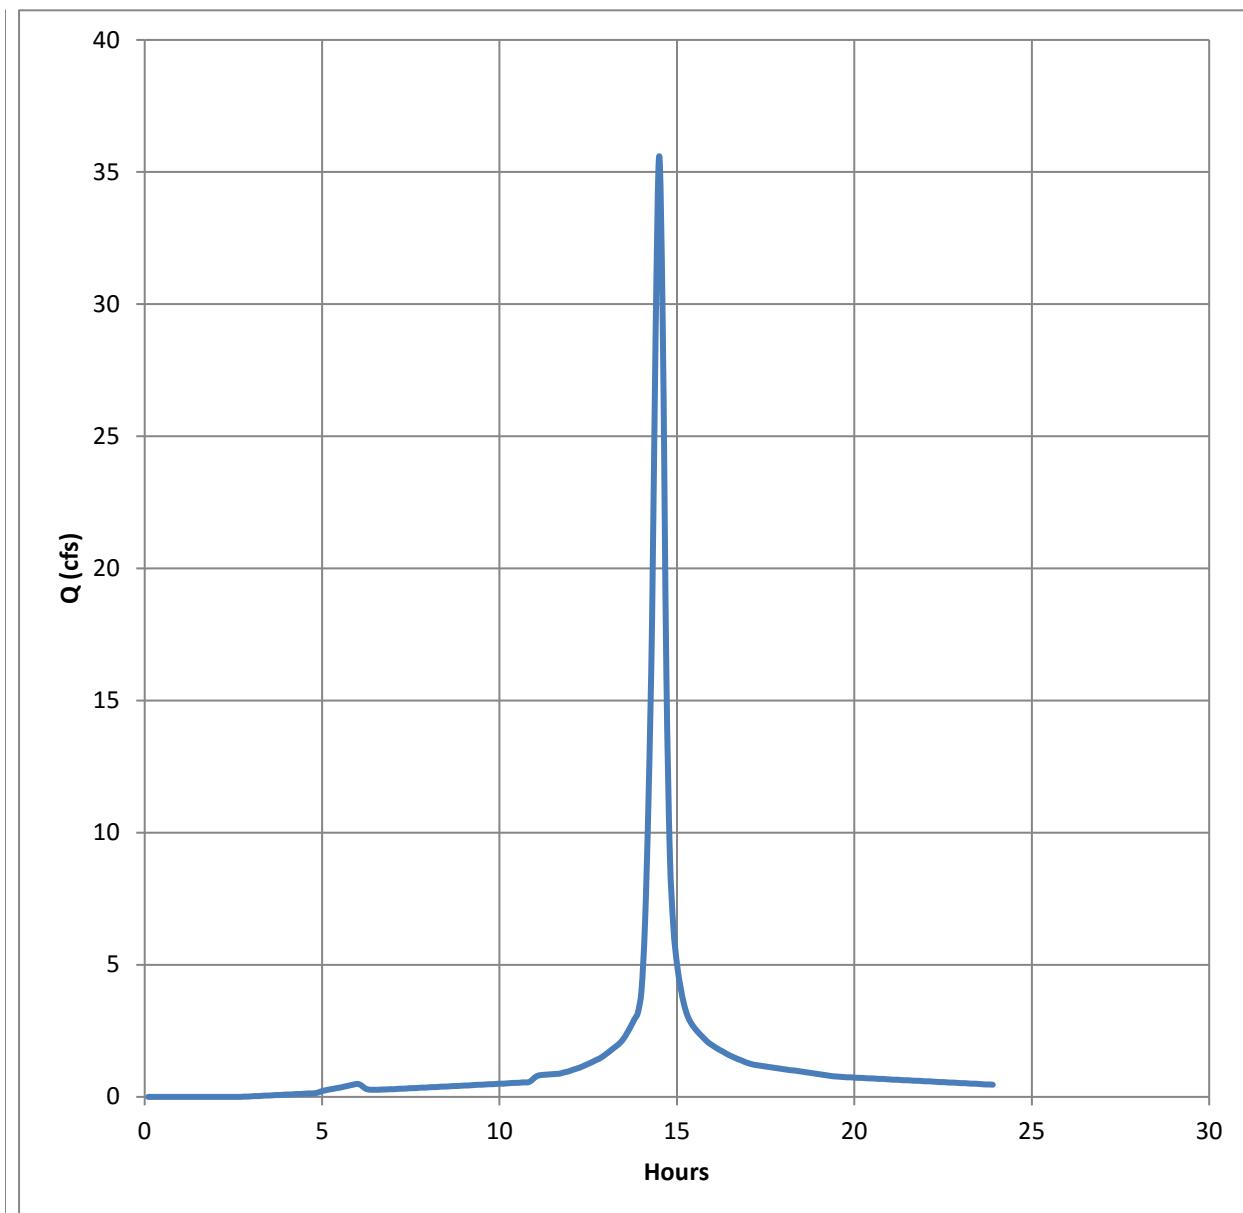

## Weatherington Residential

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	60.54
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	173,243 Ft <sup>3</sup>
Drainage Area	=	16.40 Acres	Curve Number =	74
Tc Method	=	User	Time of conc. (Tc) =	13.80 Mins
Total precip.	=	5.67 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

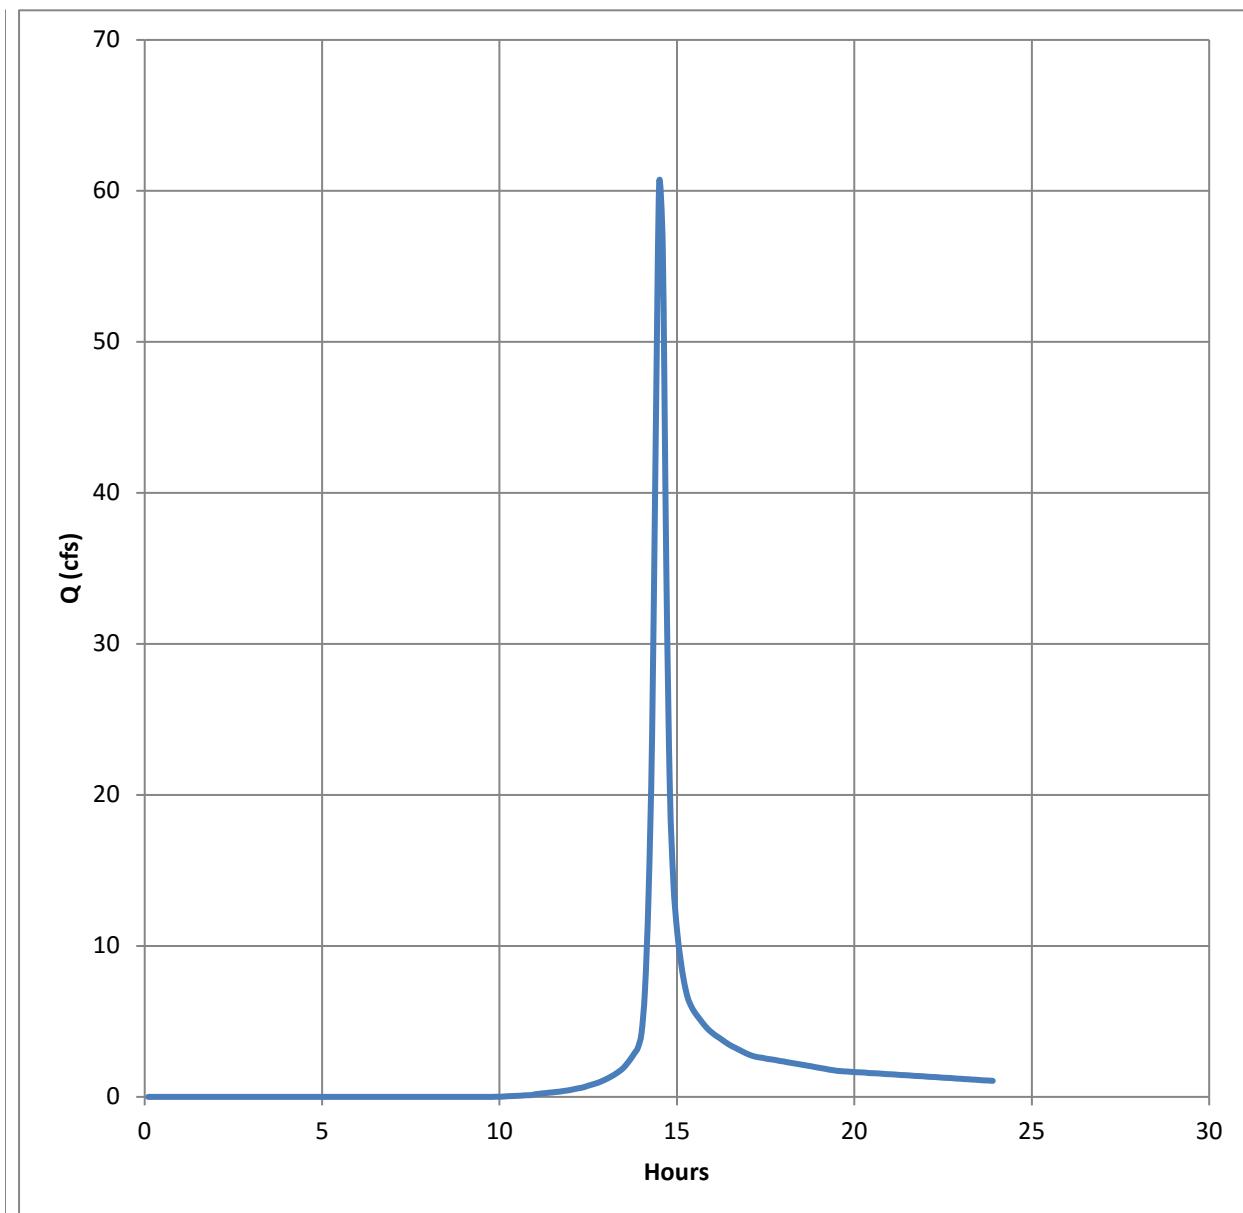

## Postdeveloped New Commercial to Basin

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	43.22
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	132,674 Ft <sup>3</sup>
Drainage Area	=	6.86 Acres	Curve Number =	96
Tc Method	=	User	Time of conc. (Tc) =	13.80 Mins
Total precip.	=	5.67 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

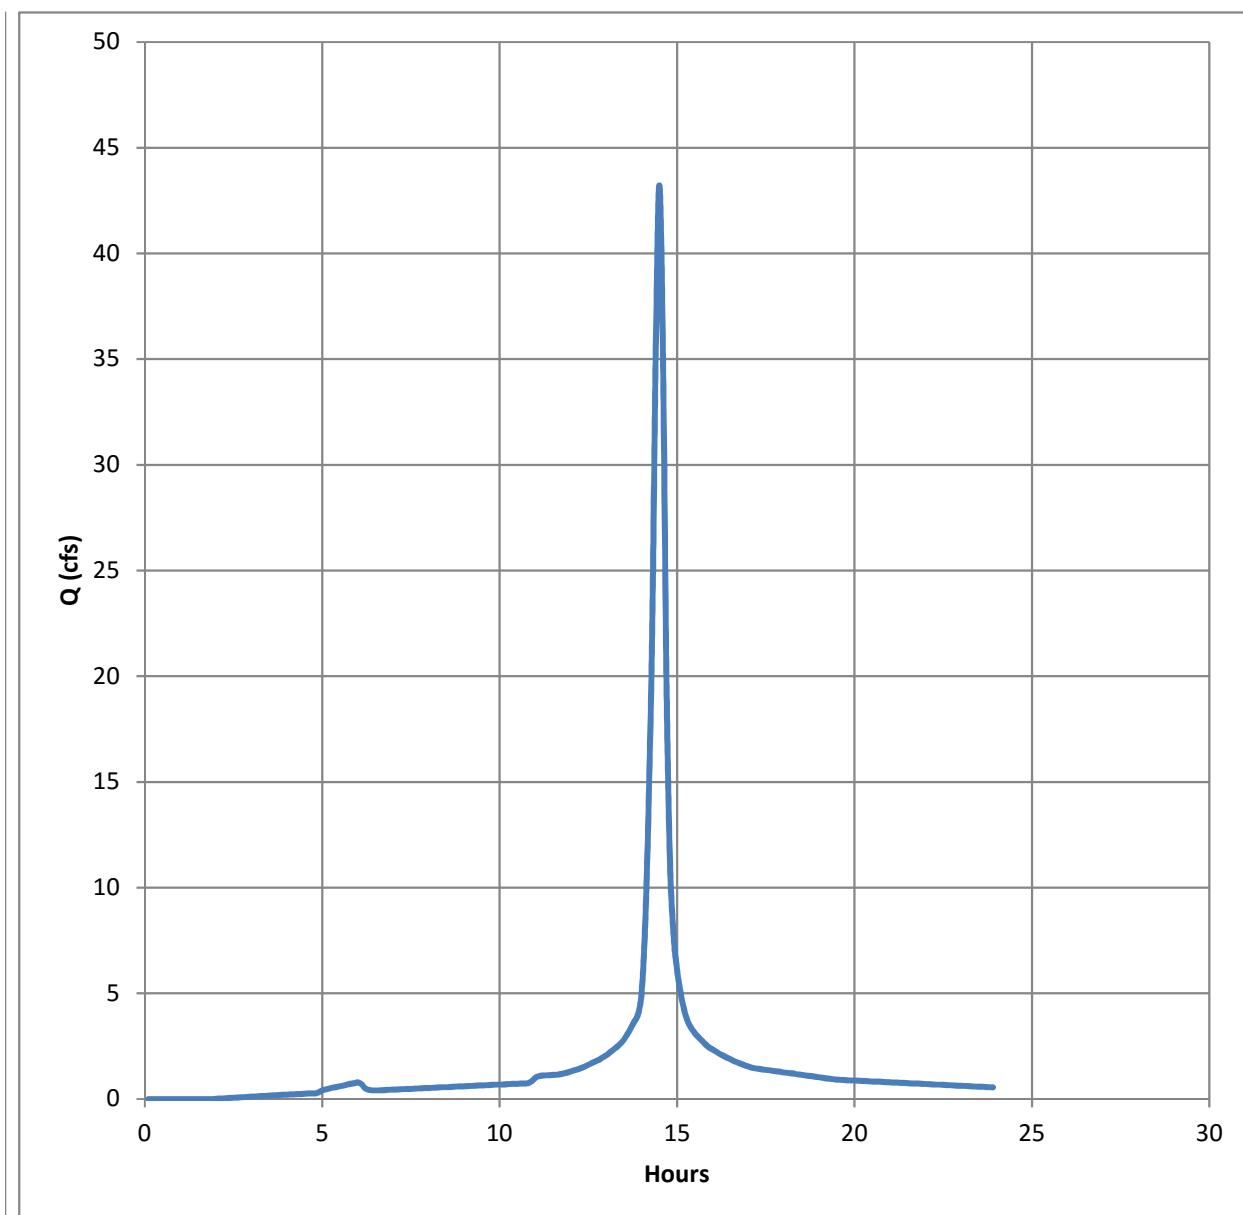

## Postdeveloped New Commercial to Bypass

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	3.56
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	10,517 Ft <sup>3</sup>
Drainage Area	=	0.80 Acres	Curve Number =	95
Tc Method	=	User	Time of conc. (Tc) =	10.00 Mins
Total precip.	=	5.67 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

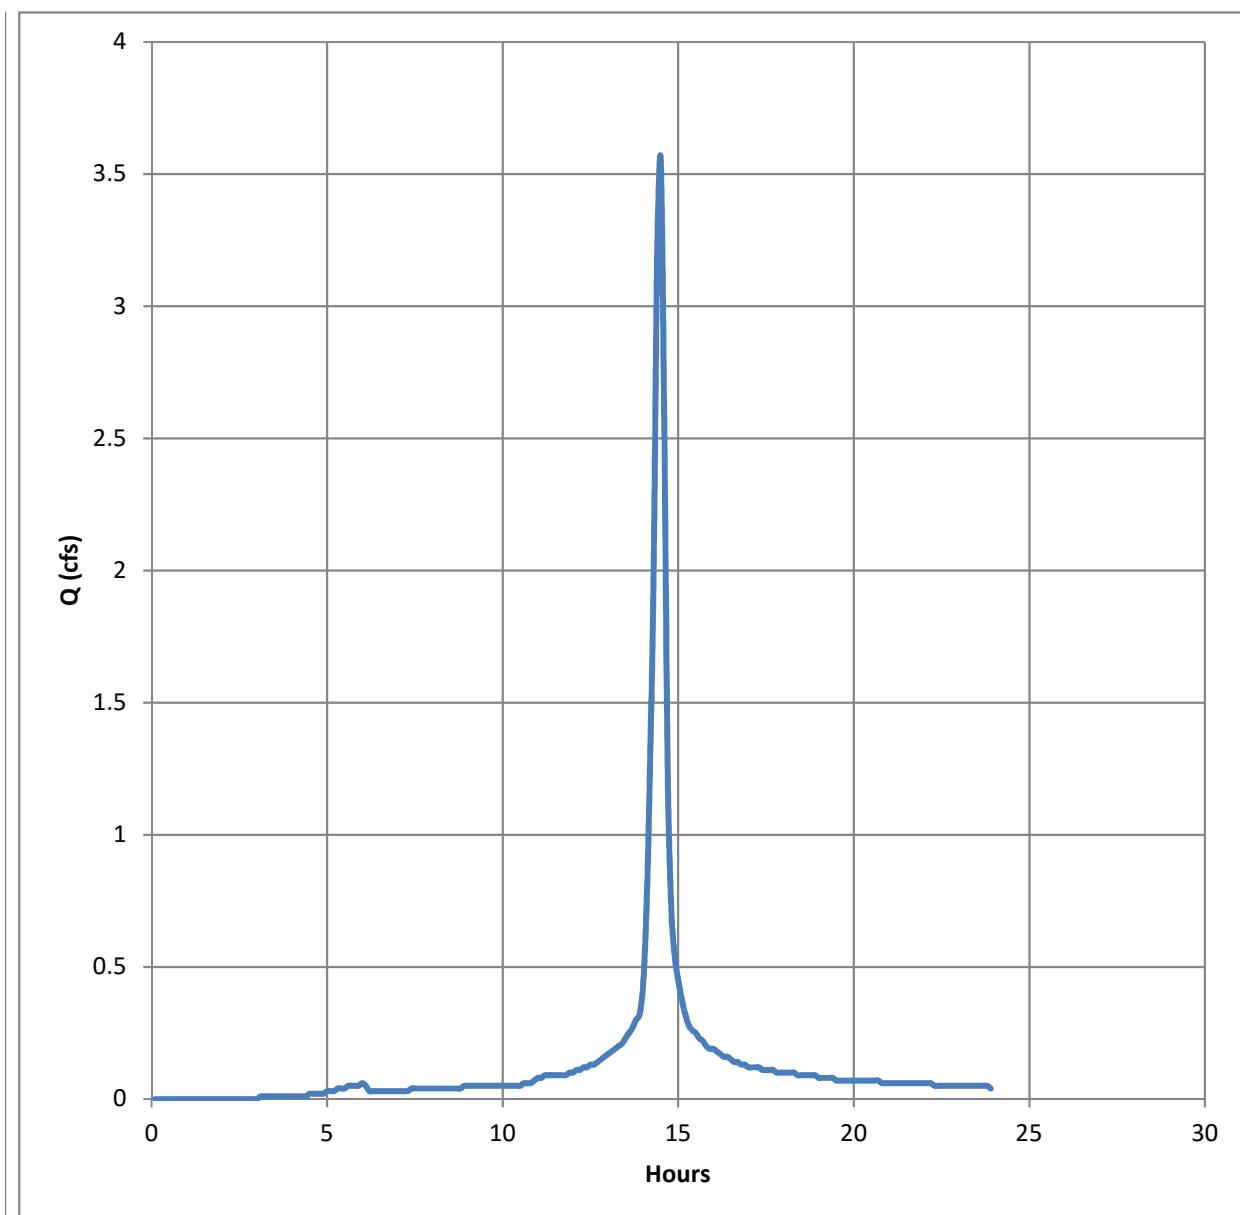

## Postdeveloped New Residential

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	25.11
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	67,792 Ft <sup>3</sup>
Drainage Area	=	5.23 Acres	Curve Number =	81
Tc Method	=	User	Time of conc. (Tc) =	10.00 Mins
Total precip.	=	5.67 in	Date =	9/8/2016
Storm Duration	=	24 hrs		


Notes:

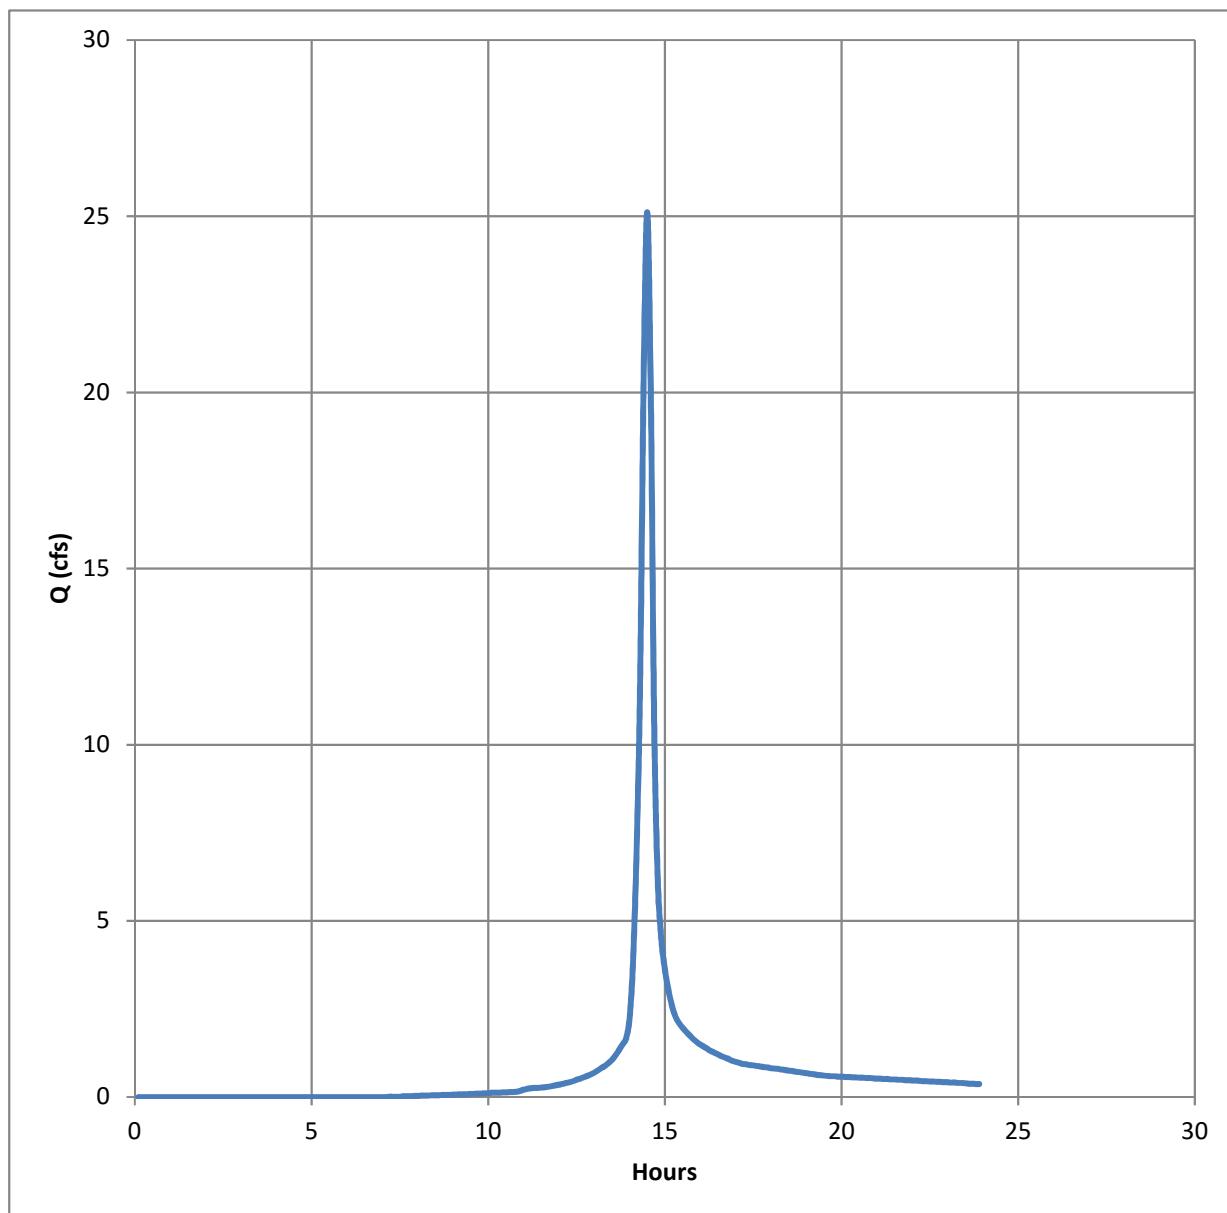

## Liberty Way Off-Site

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	37.07
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	106,730 Ft <sup>3</sup>
Drainage Area	=	6.50 Acres	Curve Number =	90
Tc Method	=	User	Time of conc. (Tc) =	11.00 Mins
Total precip.	=	5.67 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

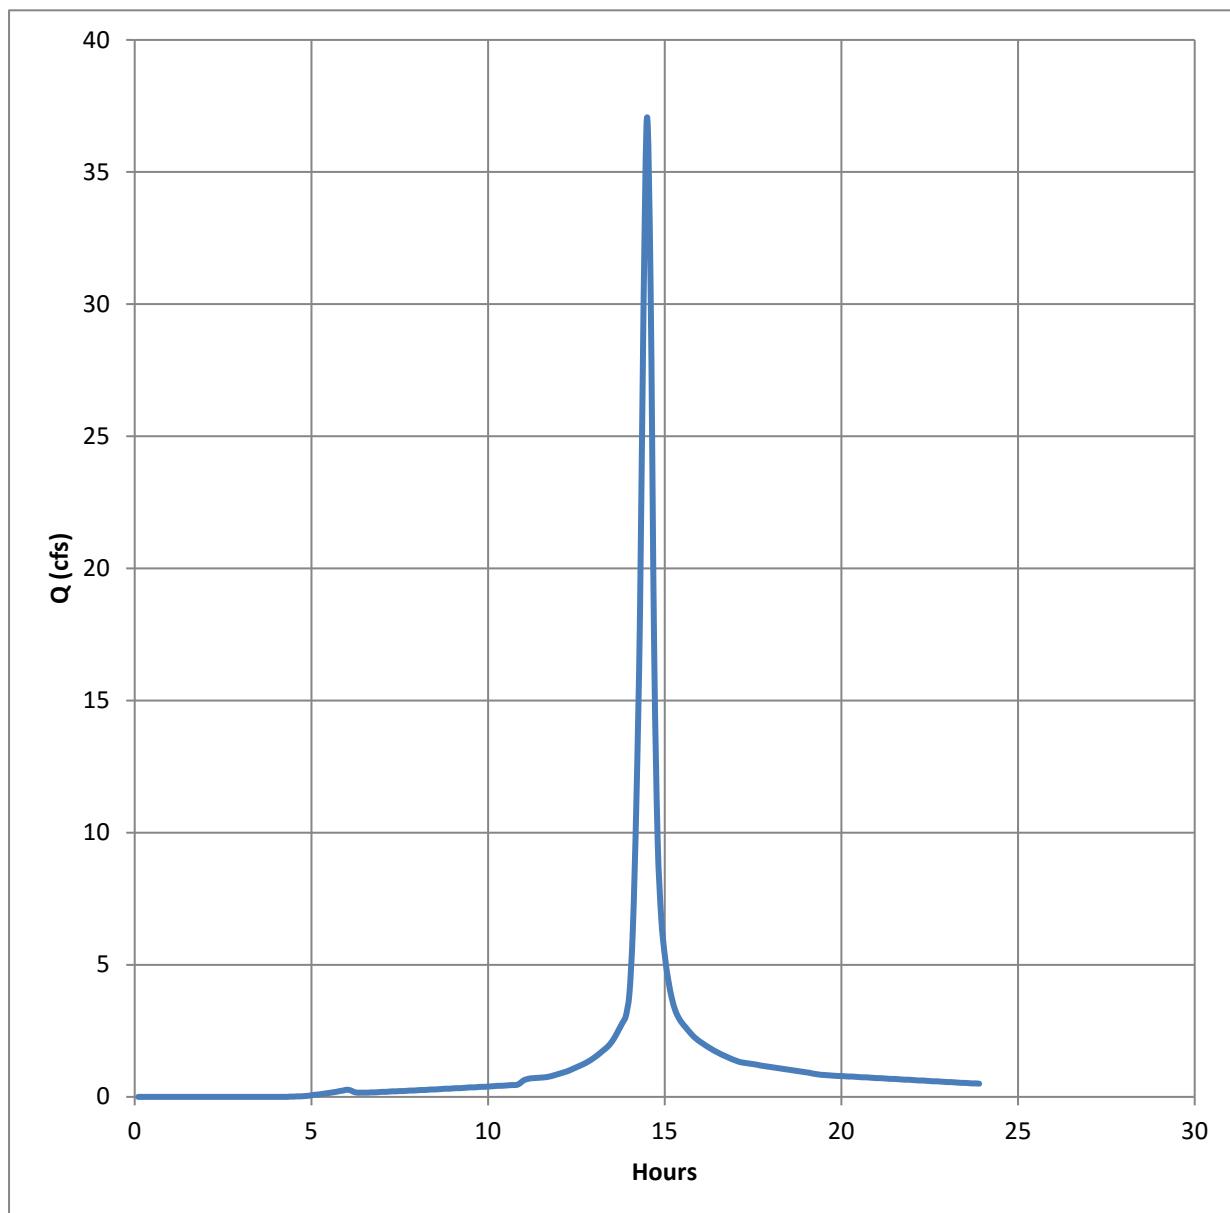

## Golf Course - Off Site

Hydrograph Type	=	SCS Runoff Type II	Peak Discharge =	137.07
Storm Frequency	=	100 yrs	Time to Peak =	12:30
Time Interval	=	6 min	Hyd. Volume =	482,093 Ft <sup>3</sup>
Drainage Area	=	41.60 Acres	Curve Number =	77
Tc Method	=	User	Time of conc. (Tc) =	22.20 Mins
Total precip.	=	5.67 in	Date =	6/2/2016
Storm Duration	=	24 hrs		


Notes:

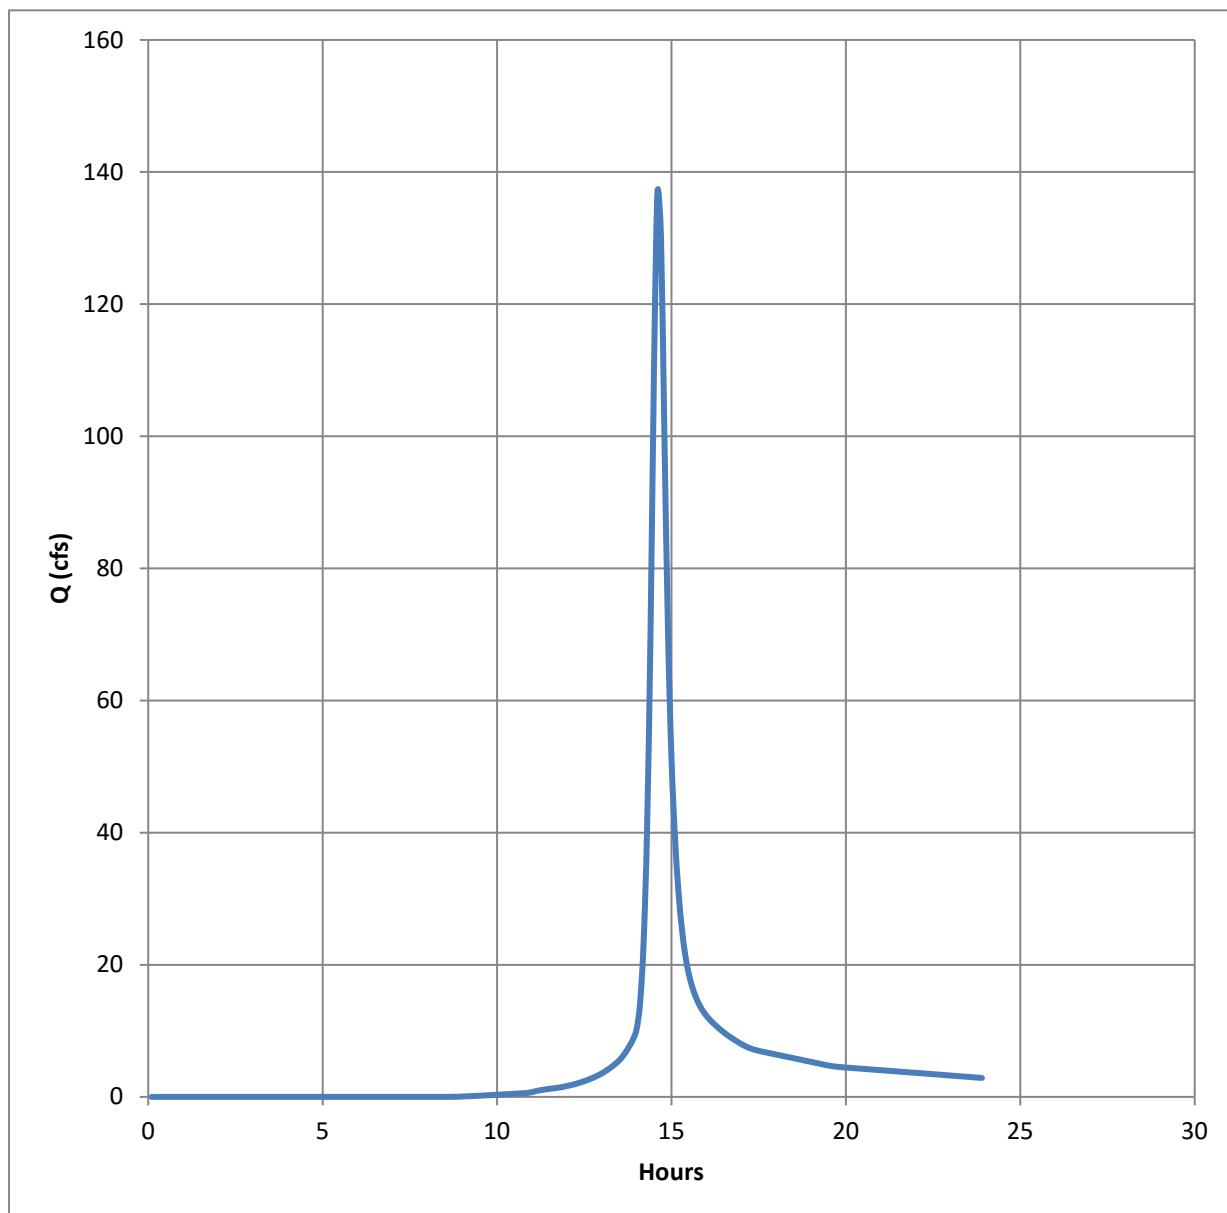

# Allowable Release Rate Hydrograph

Method of Hydrograph Development: TR-55

Software: Autodesk Storm and Sanitary Stand Alone

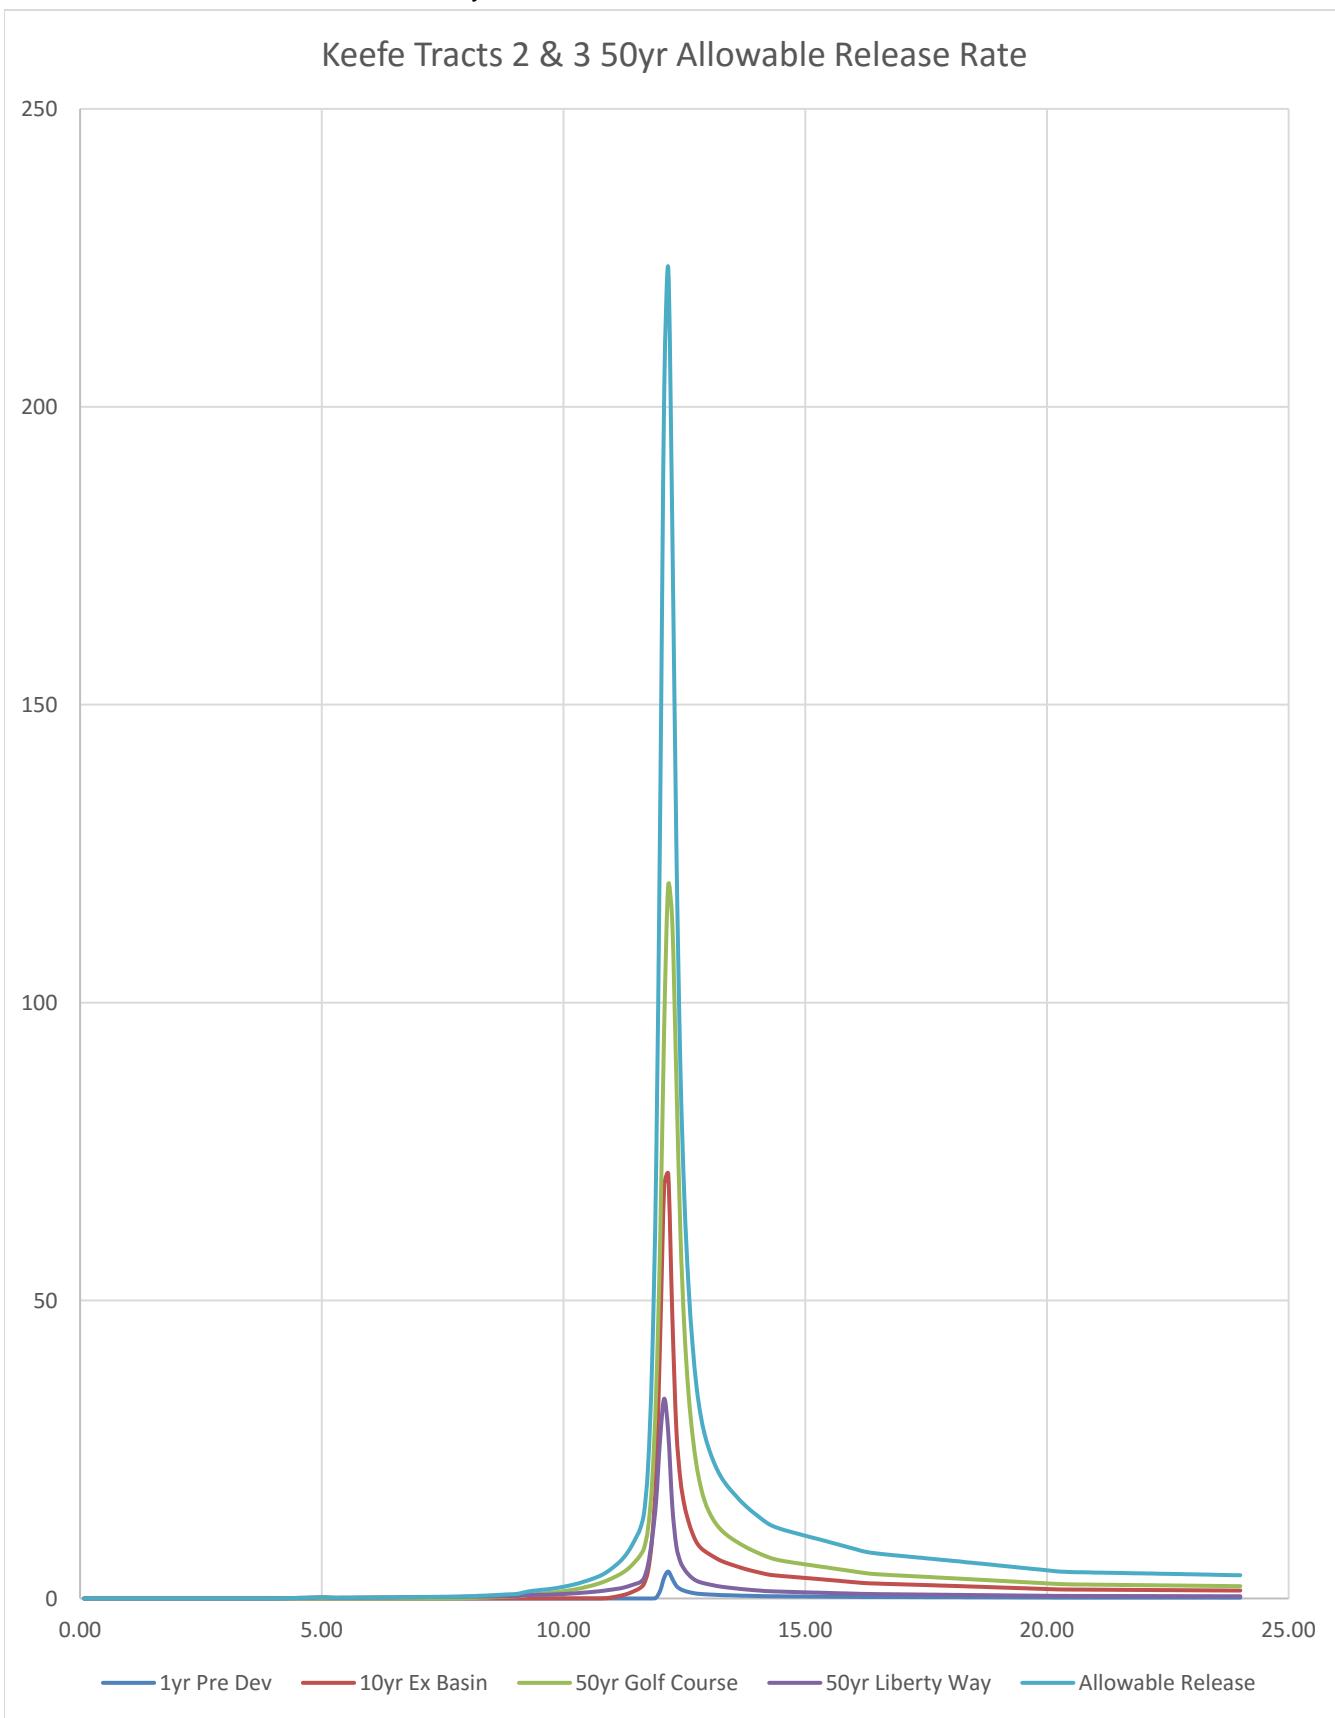

#### Peak

1yr Pre Dev	4.51 cfs Pg7 + Pg8	50yr Golf	119.72 cfs Pg 16
10yr Ex Basin	71.24 cfs Pg 6	50yr Lib Way	33.53 cfs Pg 17


50yr Allowable

223.27 cfs

## Allowable Release Rate Hydrograph

Method of Hydrograph Development: TR-55

Software: Autodesk Storm and Sanitary Stand Alone

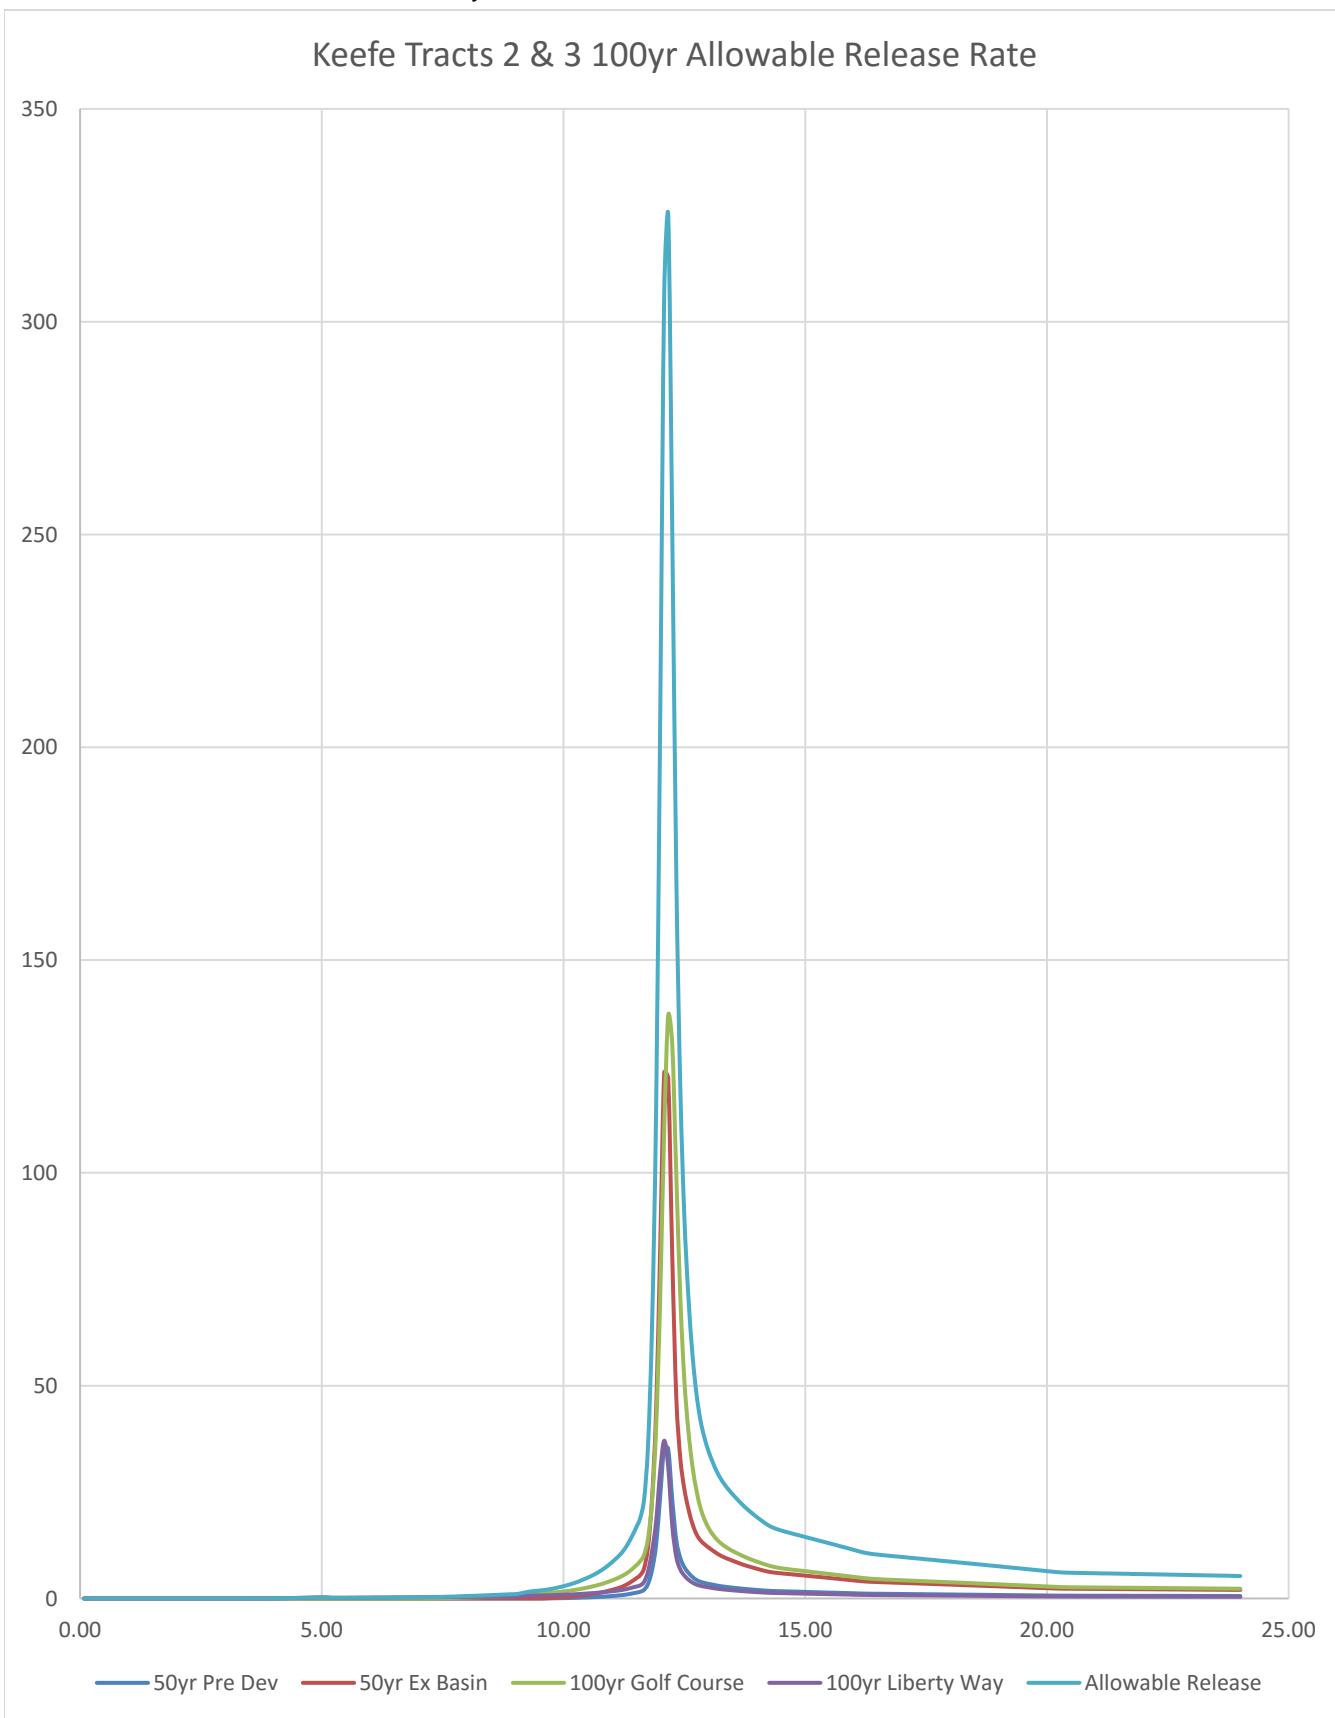

#### Peak

50yr Pre Dev	35.63 cfs	100yr Golf	137.07 cfs
50yr Ex Basin	123.57 cfs	100yr Lib Way	37.07 cfs
		100yr Allowat	325.08 cfs



## Water Quality Volume

Project: Keefe Tracts 2 & 3  
 Job No.: 15M053-000  
 Basin ID: Primary Basin

Designed By: MJL Date: 9/13/16  
 Checked By: \_\_\_\_\_ Date: \_\_\_\_\_  
 Revised By: \_\_\_\_\_ Date: \_\_\_\_\_

### Required Water Quality Volume

$$WQ_v = P C A/12$$

Site Drainage Area (A) = 81.56 acres (To Basin)  $WQ_v = \frac{2.368 \text{ acre-ft.}}{103,150 \text{ cu.ft.}}$   
 Rainfall Depth (P) = 0.75 in.  
 Runoff Coefficient (C) = 0.46  
 Residential Area (A) = 16.40 acres 75% Wet Pond 1.78 acre-ft.  
 Residential (C) = 0.40 acres 77,363 cu.ft.  
 Commercial Area (A) = 23.56 acres  
 Commercial (C) = 0.80 acres  
 Golf Course Area (A) = 41.60 acres  
 Golf Course (C) = 0.30 acres

### Water Quality Release Rate

$$Q_{wqv} = \text{Total } WQ_v/RT$$

Retention Time (RT) = 24 hours

$$Q_{wqv} = 0.90 \text{ cfs}$$

Provided Retention Time = 32.42 Hours

### Water Quality Outlet Orifice

Contour Areas	Elevation ft	Area ft <sup>2</sup>	Volume ft <sup>3</sup>	Cum. Vol. ft <sup>3</sup>	Elevation at V	Storage at Elev
Basin Inv. =	844.00	8608.90	0.00	0.00		
Contour 1 =	845.00	10164.05	9386.48	9386.48		
Contour 2 =	846.00	11827.50	10995.78	20382.25		
Contour 3 =	847.00	13596.40	12711.95	33094.20		
Contour 4 =	848.00	15472.65	14534.53	47628.73		
Contour 5 =	849.00	17455.30	16463.98	64092.70		
Contour 6 =	850.00	19545.30	18500.30	82593.00	849.72	
Contour 7 =	851.00	29644.75	24595.03	107188.03		
Contour 8 =	852.00	44649.05	37146.90	144334.93		
Contour 9 =	852.50	45317.38	56221.59	0.00		
Contour 10 =	853.00	45985.70	22825.77	22825.77		
Contour 11 =	854.00	47169.40	46577.55	69403.32		
Contour 12 =	855.00	48248.60	47709.00	117112.32	854.17	104499.82
Contour 13 =	856.00	49300.25	48774.43	165886.74		
Contour 14 =	857.00	50414.60	49857.43	215744.17		
Contour 15 =	858.00	51512.80	50963.70	266707.87		
Contour 16 =	859.00	52725.00	52118.90	318826.77		
Contour 17 =	860.00	54096.80	53410.90	372237.67		
Contour 18 =	861.00	55616.80	54856.80	427094.47		
Contour 19 =	862.00	57234.65	56425.73	483520.19		
Contour 20 =	863.00	64314.05	60774.35	544294.54		

$$Q = N C_d A_o (2 g \Delta h)^{1/2}$$

$$C_d = 0.61$$

$A_o = \pi D^2/4$  for circular orifices;  $= h * w$  for rectangular orifices

$$g = 32.20 \text{ ft/sec}^2$$

$$Q = Q_{wqv} = 0.895 \text{ cfs}$$

$$\text{Required Volume} = V = 77363 \text{ ft}^3$$

Number of orifices = N = 1

$$\text{Elevation at V} = 854.17$$

$$\text{Orifice } h = 6.000 \text{ inch}$$

$$\text{Orifice } w = 0.00 \text{ inch } (= 0 \text{ for circular orifice})$$

$$4.83 \text{ ft}$$

$$\Delta h_{min}^{avg} = (\text{Elev at V} - \text{Basin Inv})/2 - 1/2 h =$$

$$6.000 \text{ inch}$$

$$4.83 \text{ ft}$$

$$11.98 \text{ in}^2$$

$$\text{Actual } A = A_o = 28.27 \text{ in}^2$$

$$\Delta h^{avg} = (Q/(N C_d A_o))^2/(2 g) = 0.87 \text{ ft}$$

$$\text{Elev} = 854.74 > \text{Elevation at V} = 854.17 \text{ Good}$$

$$\text{Storage} = 104499.82 \text{ ft}^3$$

$$Q = 0.895 \text{ cfs}$$



## Water Quality Volume

Project: Keefe Tracts 2 & 3 Designed By: MJL Date: 6/2/16  
Job No.: 15M053-000 Checked By: \_\_\_\_\_ Date: \_\_\_\_\_  
Basin ID: Residential Revised By: \_\_\_\_\_ Date: \_\_\_\_\_

### Required Water Quality Volume

$$WQ_v = P C A/12$$

Site Drainage Area (A) =	<u>5.23</u> acres	(To Basin)	WQ <sub>v</sub> =	<u>0.119</u> acre-ft.
Rainfall Depth (P) =	<u>0.75</u> in.			<u>5,180</u> cu.ft.
Impervious Area =	<u>2.81</u> acres			
i=	<u>0.54</u>		20% Sediment	<u>1,036</u> cu.ft.
Runoff Coefficient (C) =	<u>0.36</u>		Total WQ=	<u>6,215</u> cu.ft.
$C = 0.858i^3 - 0.78i^2 + 0.774i + 0.04$				

Residential Water Quality Volume and Release Rates will be provided per each building in underground storage at building permits

# Pond Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2016 by Autodesk, Inc. v10.5

Tuesday, 07 / 26 / 2016

## Pond No. 2 - Existing Pond

### Pond Data

Contours -User-defined contour areas. Conic method used for volume calculation. Beginning Elevation = 853.10 ft

### Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	853.10	00	0	0
0.90	854.00	109	33	33
1.90	855.00	8,505	3,192	3,225
2.90	856.00	20,179	13,927	17,151
3.90	857.00	34,118	26,843	43,994
4.90	858.00	48,025	40,870	84,864
5.90	859.00	61,936	54,828	139,692
6.90	860.00	71,234	66,524	206,216
7.90	861.00	74,999	73,101	279,317

### Culvert / Orifice Structures

### Weir Structures

	[A]	[B]	[C]	[PrfRsr]		[A]	[B]	[C]	[D]
Rise (in)	= 60.00	0.00	0.00	0.00	Crest Len (ft)	= 0.00	0.00	0.00	0.00
Span (in)	= 60.00	0.00	0.00	0.00	Crest El. (ft)	= 0.00	0.00	0.00	0.00
No. Barrels	= 1	0	0	0	Weir Coeff.	= 3.33	3.33	3.33	3.33
Invert El. (ft)	= 853.10	0.00	0.00	0.00	Weir Type	= ---	---	---	---
Length (ft)	= 92.00	0.00	0.00	0.00	Multi-Stage	= No	No	No	No
Slope (%)	= 1.00	0.00	0.00	n/a					
N-Value	= .024	.013	.013	n/a					
Orifice Coeff.	= 0.60	0.60	0.60	0.60	Exfil.(in/hr)	= 0.000 (by Wet area)			
Multi-Stage	= n/a	No	No	No	TW Elev. (ft)	= 0.00			

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

### Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	PrfRsr cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Exfil cfs	User cfs	Total cfs
0.00	0	853.10	0.00	---	---	---	---	---	---	---	---	---	0.000
0.09	3	853.19	0.08 oc	---	---	---	---	---	---	---	---	---	0.077
0.18	7	853.28	0.33 ic	---	---	---	---	---	---	---	---	---	0.329
0.27	10	853.37	0.73 ic	---	---	---	---	---	---	---	---	---	0.731
0.36	13	853.46	1.29 ic	---	---	---	---	---	---	---	---	---	1.288
0.45	16	853.55	2.01 ic	---	---	---	---	---	---	---	---	---	2.015
0.54	20	853.64	2.87 ic	---	---	---	---	---	---	---	---	---	2.875
0.63	23	853.73	3.90 ic	---	---	---	---	---	---	---	---	---	3.896
0.72	26	853.82	5.04 ic	---	---	---	---	---	---	---	---	---	5.041
0.81	29	853.91	6.35 ic	---	---	---	---	---	---	---	---	---	6.346
0.90	33	854.00	7.77 ic	---	---	---	---	---	---	---	---	---	7.768
1.00	352	854.10	9.55 ic	---	---	---	---	---	---	---	---	---	9.547
1.10	671	854.20	11.46 ic	---	---	---	---	---	---	---	---	---	11.46
1.20	990	854.30	13.52 ic	---	---	---	---	---	---	---	---	---	13.52
1.30	1,309	854.40	15.79 ic	---	---	---	---	---	---	---	---	---	15.79
1.40	1,629	854.50	18.13 ic	---	---	---	---	---	---	---	---	---	18.13
1.50	1,948	854.60	20.66 ic	---	---	---	---	---	---	---	---	---	20.66
1.60	2,267	854.70	23.11 oc	---	---	---	---	---	---	---	---	---	23.11
1.70	2,586	854.80	25.54 oc	---	---	---	---	---	---	---	---	---	25.54
1.80	2,905	854.90	28.07 oc	---	---	---	---	---	---	---	---	---	28.07
1.90	3,225	855.00	30.58 oc	---	---	---	---	---	---	---	---	---	30.58
2.00	4,617	855.10	33.15 oc	---	---	---	---	---	---	---	---	---	33.15
2.10	6,010	855.20	35.79 oc	---	---	---	---	---	---	---	---	---	35.79
2.20	7,403	855.30	38.47 oc	---	---	---	---	---	---	---	---	---	38.47
2.30	8,795	855.40	41.09 oc	---	---	---	---	---	---	---	---	---	41.09
2.40	10,188	855.50	43.83 oc	---	---	---	---	---	---	---	---	---	43.83
2.50	11,581	855.60	46.49 oc	---	---	---	---	---	---	---	---	---	46.49
2.60	12,973	855.70	49.25 oc	---	---	---	---	---	---	---	---	---	49.25
2.70	14,366	855.80	51.91 oc	---	---	---	---	---	---	---	---	---	51.91
2.80	15,759	855.90	54.65 oc	---	---	---	---	---	---	---	---	---	54.65
2.90	17,151	856.00	57.37 oc	---	---	---	---	---	---	---	---	---	57.37
3.00	19,836	856.10	60.04 oc	---	---	---	---	---	---	---	---	---	60.04
3.10	22,520	856.20	62.67 oc	---	---	---	---	---	---	---	---	---	62.67
3.20	25,204	856.30	65.24 oc	---	---	---	---	---	---	---	---	---	65.24

Continues on next page...

## Existing Pond

## Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	PrfRsr cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Exfil cfs	User cfs	Total cfs
3.30	27,888	856.40	67.84 oc	---	---	---	---	---	---	---	---	---	67.84
3.40	30,573	856.50	70.35 oc	---	---	---	---	---	---	---	---	---	70.35
3.50	33,257	856.60	72.77 oc	---	---	---	---	---	---	---	---	---	72.77
3.60	35,941	856.70	75.26 oc	---	---	---	---	---	---	---	---	---	75.26
3.70	38,625	856.80	77.54 oc	---	---	---	---	---	---	---	---	---	77.54
3.80	41,310	856.90	79.84 oc	---	---	---	---	---	---	---	---	---	79.84
3.90	43,994	857.00	81.99 oc	---	---	---	---	---	---	---	---	---	81.99
4.00	48,081	857.10	84.04 oc	---	---	---	---	---	---	---	---	---	84.04
4.10	52,168	857.20	86.03 oc	---	---	---	---	---	---	---	---	---	86.03
4.20	56,255	857.30	87.87 oc	---	---	---	---	---	---	---	---	---	87.87
4.30	60,342	857.40	89.53 oc	---	---	---	---	---	---	---	---	---	89.53
4.40	64,429	857.50	91.07 oc	---	---	---	---	---	---	---	---	---	91.07
4.50	68,516	857.60	92.42 oc	---	---	---	---	---	---	---	---	---	92.42
4.60	72,603	857.70	93.53 oc	---	---	---	---	---	---	---	---	---	93.53
4.70	76,690	857.80	94.39 oc	---	---	---	---	---	---	---	---	---	94.39
4.80	80,777	857.90	94.90 oc	---	---	---	---	---	---	---	---	---	94.90
4.90	84,864	858.00	94.87 oc	---	---	---	---	---	---	---	---	---	94.87
5.00	90,347	858.10	92.96 oc	---	---	---	---	---	---	---	---	---	92.96
5.10	95,829	858.20	97.89 oc	---	---	---	---	---	---	---	---	---	97.89
5.20	101,312	858.30	102.57 oc	---	---	---	---	---	---	---	---	---	102.57
5.30	106,795	858.40	107.05 oc	---	---	---	---	---	---	---	---	---	107.05
5.40	112,278	858.50	111.35 oc	---	---	---	---	---	---	---	---	---	111.35
5.50	117,760	858.60	115.49 oc	---	---	---	---	---	---	---	---	---	115.49
5.60	123,243	858.70	119.49 oc	---	---	---	---	---	---	---	---	---	119.49
5.70	128,726	858.80	123.36 oc	---	---	---	---	---	---	---	---	---	123.36
5.80	134,209	858.90	127.11 oc	---	---	---	---	---	---	---	---	---	127.11
5.90	139,692	859.00	130.76 oc	---	---	---	---	---	---	---	---	---	130.76
6.00	146,344	859.10	134.30 oc	---	---	---	---	---	---	---	---	---	134.30
6.10	152,996	859.20	137.75 oc	---	---	---	---	---	---	---	---	---	137.75
6.20	159,649	859.30	141.12 oc	---	---	---	---	---	---	---	---	---	141.12
6.30	166,301	859.40	144.41 oc	---	---	---	---	---	---	---	---	---	144.41
6.40	172,954	859.50	147.62 oc	---	---	---	---	---	---	---	---	---	147.62
6.50	179,606	859.60	150.77 oc	---	---	---	---	---	---	---	---	---	150.77
6.60	186,258	859.70	153.85 oc	---	---	---	---	---	---	---	---	---	153.85
6.70	192,911	859.80	156.88 oc	---	---	---	---	---	---	---	---	---	156.88
6.80	199,563	859.90	159.84 oc	---	---	---	---	---	---	---	---	---	159.84
6.90	206,216	860.00	162.76 oc	---	---	---	---	---	---	---	---	---	162.76
7.00	213,526	860.10	165.62 oc	---	---	---	---	---	---	---	---	---	165.62
7.10	220,836	860.20	168.43 oc	---	---	---	---	---	---	---	---	---	168.43
7.20	228,146	860.30	171.20 oc	---	---	---	---	---	---	---	---	---	171.20
7.30	235,456	860.40	173.92 oc	---	---	---	---	---	---	---	---	---	173.92
7.40	242,766	860.50	176.60 oc	---	---	---	---	---	---	---	---	---	176.60
7.50	250,076	860.60	179.24 oc	---	---	---	---	---	---	---	---	---	179.24
7.60	257,386	860.70	181.84 oc	---	---	---	---	---	---	---	---	---	181.84
7.70	264,697	860.80	184.40 oc	---	---	---	---	---	---	---	---	---	184.40
7.80	272,007	860.90	186.93 oc	---	---	---	---	---	---	---	---	---	186.93
7.90	279,317	861.00	189.43 oc	---	---	---	---	---	---	---	---	---	189.43

...End

# Pond Report

Hydraflow Hydrographs Extension for AutoCAD® Civil 3D® 2016 by Autodesk, Inc. v10.5

Wednesday, 09 / 21 / 2016

## Pond No. 1 - Walled Pond

### Pond Data

Contours -User-defined contour areas. Conic method used for volume calculation. Beginning Elevation = 852.50 ft

### Stage / Storage Table

Stage (ft)	Elevation (ft)	Contour area (sqft)	Incr. Storage (cuft)	Total storage (cuft)
0.00	852.50	45,317	0	0
0.50	853.00	45,986	22,823	22,823
1.50	854.00	47,169	46,572	69,395
2.50	855.00	48,249	47,703	117,098
3.50	856.00	49,300	48,769	165,867
4.50	857.00	50,414	49,851	215,718
5.50	858.00	51,513	50,957	266,675
6.50	859.00	52,725	52,113	318,788
7.50	860.00	54,096	53,404	372,191
8.50	861.00	55,617	54,849	427,041
9.50	862.00	57,234	56,418	483,459
10.50	863.00	64,314	60,734	544,192

### Culvert / Orifice Structures

### Weir Structures

	[A]	[B]	[C]	[PrfRsr]		[A]	[B]	[C]	[D]
Rise (in)	= 48.00	6.00	66.00	0.00	Crest Len (ft)	= 16.00	60.00	0.00	0.00
Span (in)	= 96.00	6.00	66.00	0.00	Crest El. (ft)	= 860.50	862.54	0.00	0.00
No. Barrels	= 1	1	1	0	Weir Coeff.	= 3.33	2.60	3.33	3.33
Invert El. (ft)	= 852.19	852.50	854.50	0.00	Weir Type	= 1	Broad	---	---
Length (ft)	= 461.00	0.00	0.00	0.00	Multi-Stage	= Yes	No	No	No
Slope (%)	= 0.30	0.00	0.00	n/a	Exfil.(in/hr)	= 0.000 (by Contour)			
N-Value	= .015	.015	.015	n/a	TW Elev. (ft)	= 0.00			
Orifice Coeff.	= 0.61	0.61	0.61	0.60					
Multi-Stage	= n/a	Yes	Yes	No					

Note: Culvert/Orifice outflows are analyzed under inlet (ic) and outlet (oc) control. Weir risers checked for orifice conditions (ic) and submergence (s).

### Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	PrfRsr cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Exfil cfs	User cfs	Total cfs
0.00	0	852.50	0.00	0.00	0.00	---	0.00	0.00	---	---	---	---	0.000
0.05	2,282	852.55	4.81 ic	0.01 ic	0.00	---	0.00	0.00	---	---	---	---	0.008
0.10	4,565	852.60	4.81 ic	0.03 ic	0.00	---	0.00	0.00	---	---	---	---	0.032
0.15	6,847	852.65	4.81 ic	0.07 ic	0.00	---	0.00	0.00	---	---	---	---	0.067
0.20	9,129	852.70	4.81 ic	0.12 ic	0.00	---	0.00	0.00	---	---	---	---	0.117
0.25	11,412	852.75	4.81 ic	0.17 ic	0.00	---	0.00	0.00	---	---	---	---	0.171
0.30	13,694	852.80	4.81 ic	0.24 ic	0.00	---	0.00	0.00	---	---	---	---	0.235
0.35	15,976	852.85	4.81 ic	0.31 ic	0.00	---	0.00	0.00	---	---	---	---	0.305
0.40	18,259	852.90	4.81 ic	0.37 ic	0.00	---	0.00	0.00	---	---	---	---	0.371
0.45	20,541	852.95	4.81 ic	0.43 ic	0.00	---	0.00	0.00	---	---	---	---	0.435
0.50	22,823	853.00	4.81 ic	0.48 ic	0.00	---	0.00	0.00	---	---	---	---	0.484
0.60	27,480	853.10	4.81 ic	0.57 ic	0.00	---	0.00	0.00	---	---	---	---	0.572
0.70	32,138	853.20	4.81 ic	0.65 ic	0.00	---	0.00	0.00	---	---	---	---	0.649
0.80	36,795	853.30	4.81 ic	0.72 ic	0.00	---	0.00	0.00	---	---	---	---	0.717
0.90	41,452	853.40	4.81 ic	0.78 ic	0.00	---	0.00	0.00	---	---	---	---	0.780
1.00	46,109	853.50	4.81 ic	0.84 ic	0.00	---	0.00	0.00	---	---	---	---	0.838
1.10	50,766	853.60	4.81 ic	0.89 ic	0.00	---	0.00	0.00	---	---	---	---	0.892
1.20	55,423	853.70	4.81 ic	0.94 ic	0.00	---	0.00	0.00	---	---	---	---	0.943
1.30	60,081	853.80	4.81 ic	0.99 ic	0.00	---	0.00	0.00	---	---	---	---	0.991
1.40	64,738	853.90	4.81 ic	1.04 ic	0.00	---	0.00	0.00	---	---	---	---	1.037
1.50	69,395	854.00	4.81 ic	1.08 ic	0.00	---	0.00	0.00	---	---	---	---	1.082
1.60	74,165	854.10	4.81 ic	1.12 ic	0.00	---	0.00	0.00	---	---	---	---	1.124
1.70	78,936	854.20	4.81 ic	1.16 ic	0.00	---	0.00	0.00	---	---	---	---	1.165
1.80	83,706	854.30	4.81 ic	1.20 ic	0.00	---	0.00	0.00	---	---	---	---	1.204
1.90	88,476	854.40	4.81 ic	1.24 ic	0.00	---	0.00	0.00	---	---	---	---	1.243
2.00	93,246	854.50	4.81 ic	1.28 ic	0.00	---	0.00	0.00	---	---	---	---	1.280
2.10	98,017	854.60	4.81 ic	1.32 ic	0.12 ic	---	0.00	0.00	---	---	---	---	1.439
2.20	102,787	854.70	4.81 ic	1.35 ic	0.46 ic	---	0.00	0.00	---	---	---	---	1.812
2.30	107,557	854.80	4.81 ic	1.38 ic	1.06 ic	---	0.00	0.00	---	---	---	---	2.444
2.40	112,328	854.90	4.81 ic	1.42 ic	1.74 ic	---	0.00	0.00	---	---	---	---	3.156
2.50	117,098	855.00	4.81 ic	1.45 ic	2.65 ic	---	0.00	0.00	---	---	---	---	4.100

Continues on next page...

## Walled Pond

## Stage / Storage / Discharge Table

Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	PrfRsr cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Exfil cfs	User cfs	Total cfs
2.60	121,975	855.10	5.31 ic	1.48 ic	3.83 ic	---	0.00	0.00	---	---	---	---	5.309
2.70	126,852	855.20	6.82 ic	1.51 ic	5.30 ic	---	0.00	0.00	---	---	---	---	6.816
2.80	131,729	855.30	8.27 ic	1.54 ic	6.73 ic	---	0.00	0.00	---	---	---	---	8.270
2.90	136,606	855.40	10.38 ic	1.57 ic	8.80 ic	---	0.00	0.00	---	---	---	---	10.38
3.00	141,482	855.50	12.33 ic	1.60 ic	10.73 ic	---	0.00	0.00	---	---	---	---	12.33
3.10	146,359	855.60	14.51 ic	1.61 ic	12.90 ic	---	0.00	0.00	---	---	---	---	14.51
3.20	151,236	855.70	16.31 ic	1.62 ic	14.69 ic	---	0.00	0.00	---	---	---	---	16.31
3.30	156,113	855.80	18.92 ic	1.63 ic	17.29 ic	---	0.00	0.00	---	---	---	---	18.92
3.40	160,990	855.90	21.78 ic	1.64 ic	20.14 ic	---	0.00	0.00	---	---	---	---	21.77
3.50	165,867	856.00	24.08 ic	1.65 ic	22.43 ic	---	0.00	0.00	---	---	---	---	24.08
3.60	170,852	856.10	27.37 ic	1.65 ic	25.72 ic	---	0.00	0.00	---	---	---	---	27.37
3.70	175,837	856.20	30.92 ic	1.66 ic	29.25 ic	---	0.00	0.00	---	---	---	---	30.91
3.80	180,822	856.30	33.71 ic	1.67 ic	32.05 ic	---	0.00	0.00	---	---	---	---	33.71
3.90	185,807	856.40	36.65 ic	1.68 ic	34.97 ic	---	0.00	0.00	---	---	---	---	36.64
4.00	190,792	856.50	40.78 ic	1.68 ic	39.10 ic	---	0.00	0.00	---	---	---	---	40.78
4.10	195,777	856.60	44.01 ic	1.69 ic	42.31 ic	---	0.00	0.00	---	---	---	---	44.00
4.20	200,762	856.70	48.52 ic	1.69 ic	46.83 ic	---	0.00	0.00	---	---	---	---	48.52
4.30	205,748	856.80	52.02 ic	1.70 ic	50.32 ic	---	0.00	0.00	---	---	---	---	52.02
4.40	210,733	856.90	55.63 ic	1.71 ic	53.91 ic	---	0.00	0.00	---	---	---	---	55.62
4.50	215,718	857.00	60.63 ic	1.71 ic	58.91 ic	---	0.00	0.00	---	---	---	---	60.62
4.60	220,814	857.10	64.46 ic	1.72 ic	62.74 ic	---	0.00	0.00	---	---	---	---	64.46
4.70	225,909	857.20	68.38 ic	1.73 ic	66.65 ic	---	0.00	0.00	---	---	---	---	68.38
4.80	231,005	857.30	73.76 ic	1.73 ic	72.02 ic	---	0.00	0.00	---	---	---	---	73.75
4.90	236,101	857.40	77.85 ic	1.74 ic	76.11 ic	---	0.00	0.00	---	---	---	---	77.85
5.00	241,196	857.50	82.01 ic	1.75 ic	80.26 ic	---	0.00	0.00	---	---	---	---	82.01
5.10	246,292	857.60	87.65 oc	1.75 ic	85.90 ic	---	0.00	0.00	---	---	---	---	87.65
5.20	251,388	857.70	91.92 oc	1.75 ic	90.16 ic	---	0.00	0.00	---	---	---	---	91.91
5.30	256,484	857.80	96.22 oc	1.76 ic	94.46 ic	---	0.00	0.00	---	---	---	---	96.22
5.40	261,579	857.90	101.98 oc	1.75 ic	100.23 ic	---	0.00	0.00	---	---	---	---	101.98
5.50	266,675	858.00	106.33 oc	1.76 ic	104.58 ic	---	0.00	0.00	---	---	---	---	106.33
5.60	271,886	858.10	112.10 oc	1.75 ic	110.34 ic	---	0.00	0.00	---	---	---	---	112.09
5.70	277,998	858.20	116.44 oc	1.76 ic	114.68 ic	---	0.00	0.00	---	---	---	---	116.44
5.80	282,309	858.30	120.78 oc	1.76 ic	119.01 ic	---	0.00	0.00	---	---	---	---	120.77
5.90	287,520	858.40	126.43 oc	1.76 ic	124.67 ic	---	0.00	0.00	---	---	---	---	126.43
6.00	292,731	858.50	131.99 oc	1.76 ic	130.23 ic	---	0.00	0.00	---	---	---	---	131.99
6.10	297,943	858.60	136.19 oc	1.76 ic	134.42 ic	---	0.00	0.00	---	---	---	---	136.18
6.20	303,154	858.70	141.55 oc	1.76 ic	139.78 ic	---	0.00	0.00	---	---	---	---	141.55
6.30	308,365	858.80	146.76 oc	1.76 ic	145.00 ic	---	0.00	0.00	---	---	---	---	146.76
6.40	313,576	858.90	150.72 oc	1.77 ic	148.95 ic	---	0.00	0.00	---	---	---	---	150.71
6.50	318,788	859.00	155.66 oc	1.77 ic	153.88 ic	---	0.00	0.00	---	---	---	---	155.65
6.60	324,128	859.10	160.39 oc	1.77 ic	158.62 ic	---	0.00	0.00	---	---	---	---	160.39
6.70	329,469	859.20	165.81 oc	1.77 ic	164.04 ic	---	0.00	0.00	---	---	---	---	165.81
6.80	334,809	859.30	170.06 oc	1.78 ic	168.28 ic	---	0.00	0.00	---	---	---	---	170.06
6.90	340,149	859.40	174.78 oc	1.78 ic	173.00 ic	---	0.00	0.00	---	---	---	---	174.78
7.00	345,490	859.50	178.50 oc	1.79 ic	176.72 ic	---	0.00	0.00	---	---	---	---	178.50
7.10	350,830	859.60	183.02 oc	1.79 ic	181.23 ic	---	0.00	0.00	---	---	---	---	183.02
7.20	356,170	859.70	186.43 oc	1.68 ic	184.75 ic	---	0.00	0.00	---	---	---	---	186.43
7.30	361,511	859.80	190.15 oc	1.69 ic	188.46 ic	---	0.00	0.00	---	---	---	---	190.15
7.40	366,851	859.90	193.29 oc	1.70 ic	191.59 ic	---	0.00	0.00	---	---	---	---	193.28
7.50	372,191	860.00	195.82 oc	1.71 ic	194.11 ic	---	0.00	0.00	---	---	---	---	195.82
7.60	377,676	860.10	199.32 oc	1.72 ic	197.60 ic	---	0.00	0.00	---	---	---	---	199.32
7.70	383,161	860.20	202.77 oc	1.72 ic	201.04 ic	---	0.00	0.00	---	---	---	---	202.77
7.80	388,646	860.30	206.15 oc	1.73 ic	204.42 ic	---	0.00	0.00	---	---	---	---	206.15
7.90	394,131	860.40	209.48 oc	1.74 ic	207.74 ic	---	0.00	0.00	---	---	---	---	209.48
8.00	399,616	860.50	212.76 oc	1.75 ic	211.01 ic	---	0.00	0.00	---	---	---	---	212.76
8.10	405,101	860.60	215.67 oc	1.75 ic	212.23 ic	---	1.68	0.00	---	---	---	---	215.67
8.20	410,586	860.70	219.27 oc	1.76 ic	212.74 ic	---	4.76	0.00	---	---	---	---	219.26
8.30	416,071	860.80	223.34 oc	1.76 ic	212.84 ic	---	8.75	0.00	---	---	---	---	223.34
8.40	421,556	860.90	227.80 oc	1.76 ic	212.57 ic	---	13.47	0.00	---	---	---	---	227.79
8.50	427,041	861.00	232.57 oc	1.75 ic	211.98 ic	---	18.84	0.00	---	---	---	---	232.57
8.60	432,683	861.10	237.60 oc	1.74 ic	211.09 ic	---	24.76	0.00	---	---	---	---	237.60
8.70	438,324	861.20	242.86 oc	1.73 ic	209.92 ic	---	31.20	0.00	---	---	---	---	242.86
8.80	443,966	861.30	248.31 oc	1.72 ic	208.47 ic	---	38.12	0.00	---	---	---	---	248.31
8.90	449,608	861.40	253.94 oc	1.71 ic	206.74 ic	---	45.48	0.00	---	---	---	---	253.94
9.00	455,250	861.50	259.72 oc	1.69 ic	204.75 ic	---	53.27	0.00	---	---	---	---	259.72
9.10	460,891	861.60	265.63 oc	1.67 ic	202.49 ic	---	61.46	0.00	---	---	---	---	265.63
9.20	466,533	861.70	271.65 oc	1.65 ic	199.97 ic	---	70.02	0.00	---	---	---	---	271.64
9.30	472,175	861.80	277.76 oc	1.63 ic	197.17 ic	---	78.96	0.00	---	---	---	---	277.76
9.40	477,817	861.90	283.96 oc	1.60 ic	194.11 ic	---	88.24	0.00	---	---	---	---	283.95
9.50	483,459	862.00	290.23 oc	1.58 ic	190.77 ic	---	97.88	0.00	---	---	---	---	290.23
9.60	489,532	862.10	296.54 oc	1.55 ic	187.16 ic	---	107.83	0.00	---	---	---	---	296.54
9.70	495,605	862.20	302.90 oc	1.51 ic	183.28 ic	---	118.10	0.00	---	---	---	---	302.89

Continues on next page...

## Walled Pond

## Stage / Storage / Discharge Table


Stage ft	Storage cuft	Elevation ft	Clv A cfs	Clv B cfs	Clv C cfs	PrfRsr cfs	Wr A cfs	Wr B cfs	Wr C cfs	Wr D cfs	Exfil cfs	User cfs	Total cfs
9.80	501,679	862.30	309.26 oc	1.48 ic	179.12 ic	---	128.66	0.00	---	---	---	---	309.26
9.90	507,752	862.40	315.65 oc	1.44 ic	174.67 ic	---	139.53	0.00	---	---	---	---	315.64
10.00	513,825	862.50	322.03 oc	1.40 ic	169.93 ic	---	150.68	0.00	---	---	---	---	322.02
10.10	519,899	862.60	321.69 oc	1.44 ic	174.38 ic	---	124.66 ic	2.29	---	---	---	---	302.77
10.20	525,972	862.70	321.37 oc	1.48 ic	178.68 ic	---	127.59 ic	9.97	---	---	---	---	317.73
10.30	532,045	862.80	321.05 oc	1.51 ic	182.89 ic	---	130.46 ic	20.66	---	---	---	---	335.52
10.40	538,119	862.90	321.21 oc	1.54 ic	186.40 ic	---	133.27 ic	33.67	---	---	---	---	354.87
10.50	544,192	863.00	324.04 oc	1.54 ic	186.47 ic	---	136.02 ic	48.67	---	---	---	---	372.71

...End

## Cabelas Basin

Hydrograph Type	=	Reservoir	Peak Discharge =	102.19
Storm Frequency	=	50 yrs	Time to Peak =	12:10 hrs
Time Interval	=	6 min	Max Elevation =	871.41
			Max Storage =	107,120 Ft <sup>3</sup>
			Date =	6/2/2016


Notes:

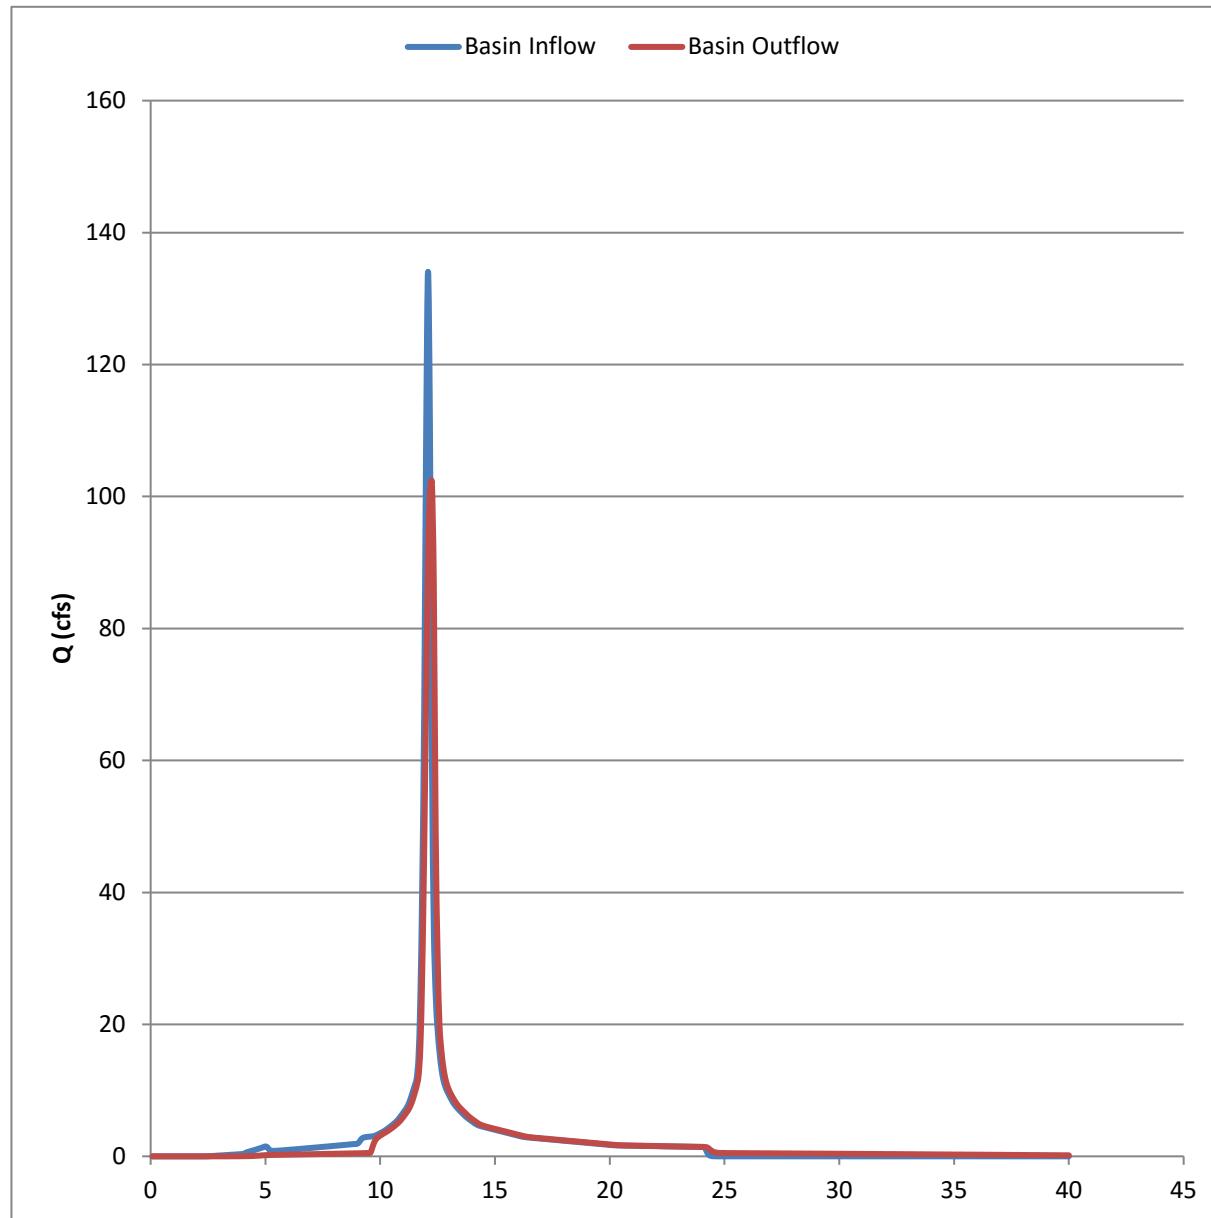

## Existing Pond

Hydrograph Type	=	Reservoir	Peak Discharge =	41.16
Storm Frequency	=	50 yrs	Time to Peak =	12:25 hrs
Time Interval	=	6 min	Max Elevation =	866.25
			Max Storage =	42,017 Ft <sup>3</sup>
			Date =	6/2/2016


Notes:

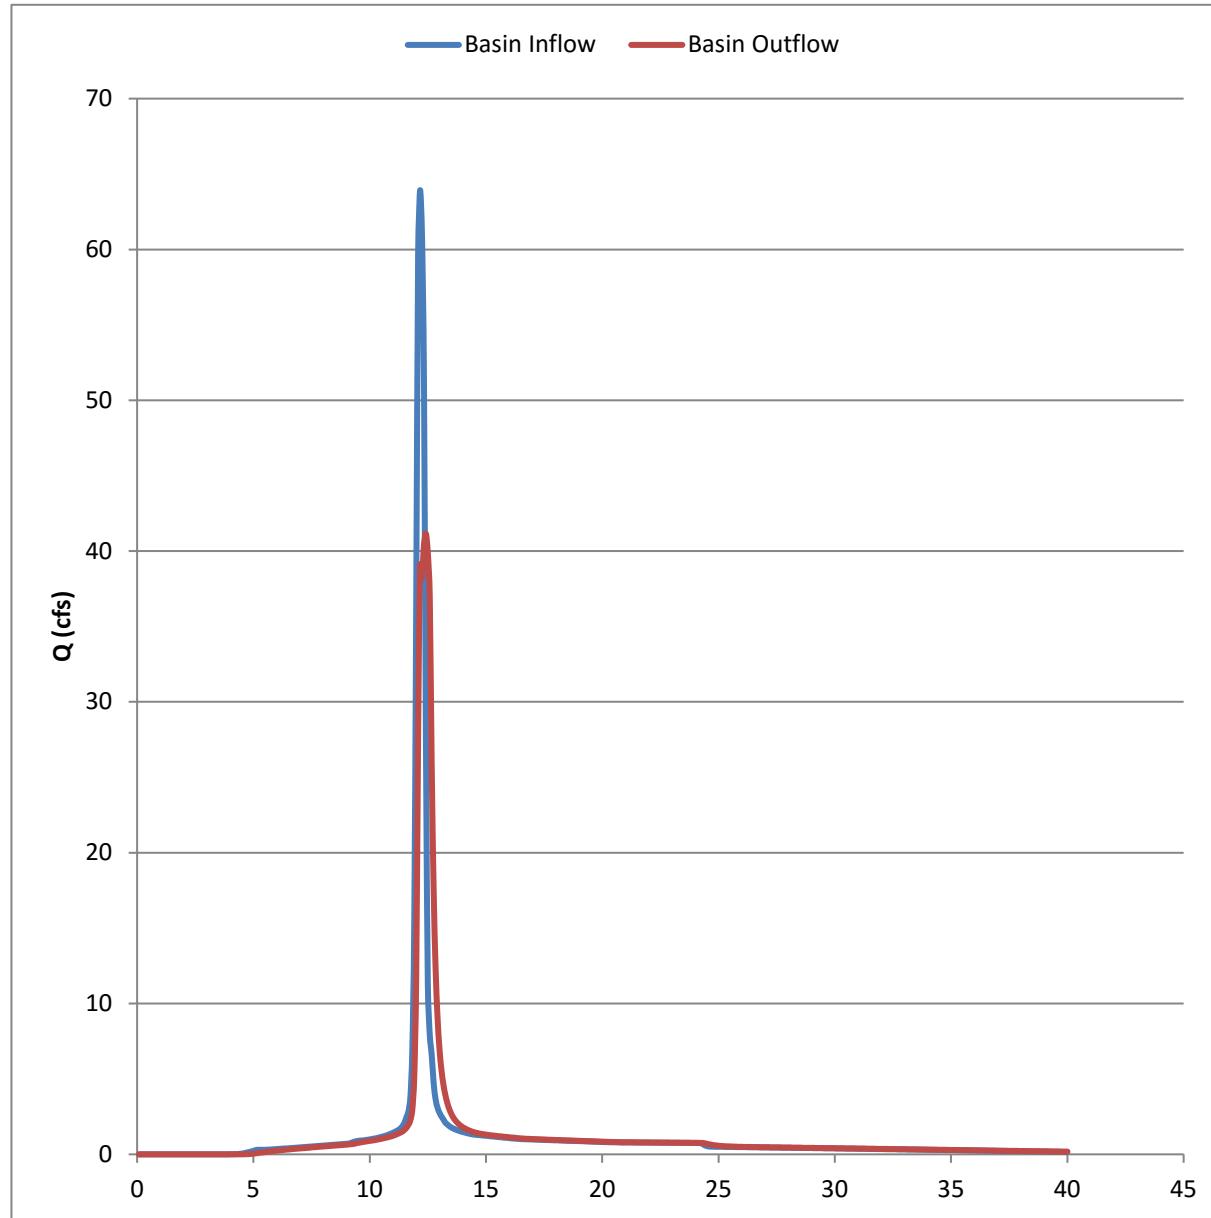

## Primary Basin

Hydrograph Type	=	Reservoir	Peak Discharge =	178.22
Storm Frequency	=	50 yrs	Time to Peak =	12:25 hrs
Time Interval	=	6 min	Max Elevation =	859.66
			Max Storage =	353,622 Ft <sup>3</sup>
			Date =	9/21/2016


Notes:

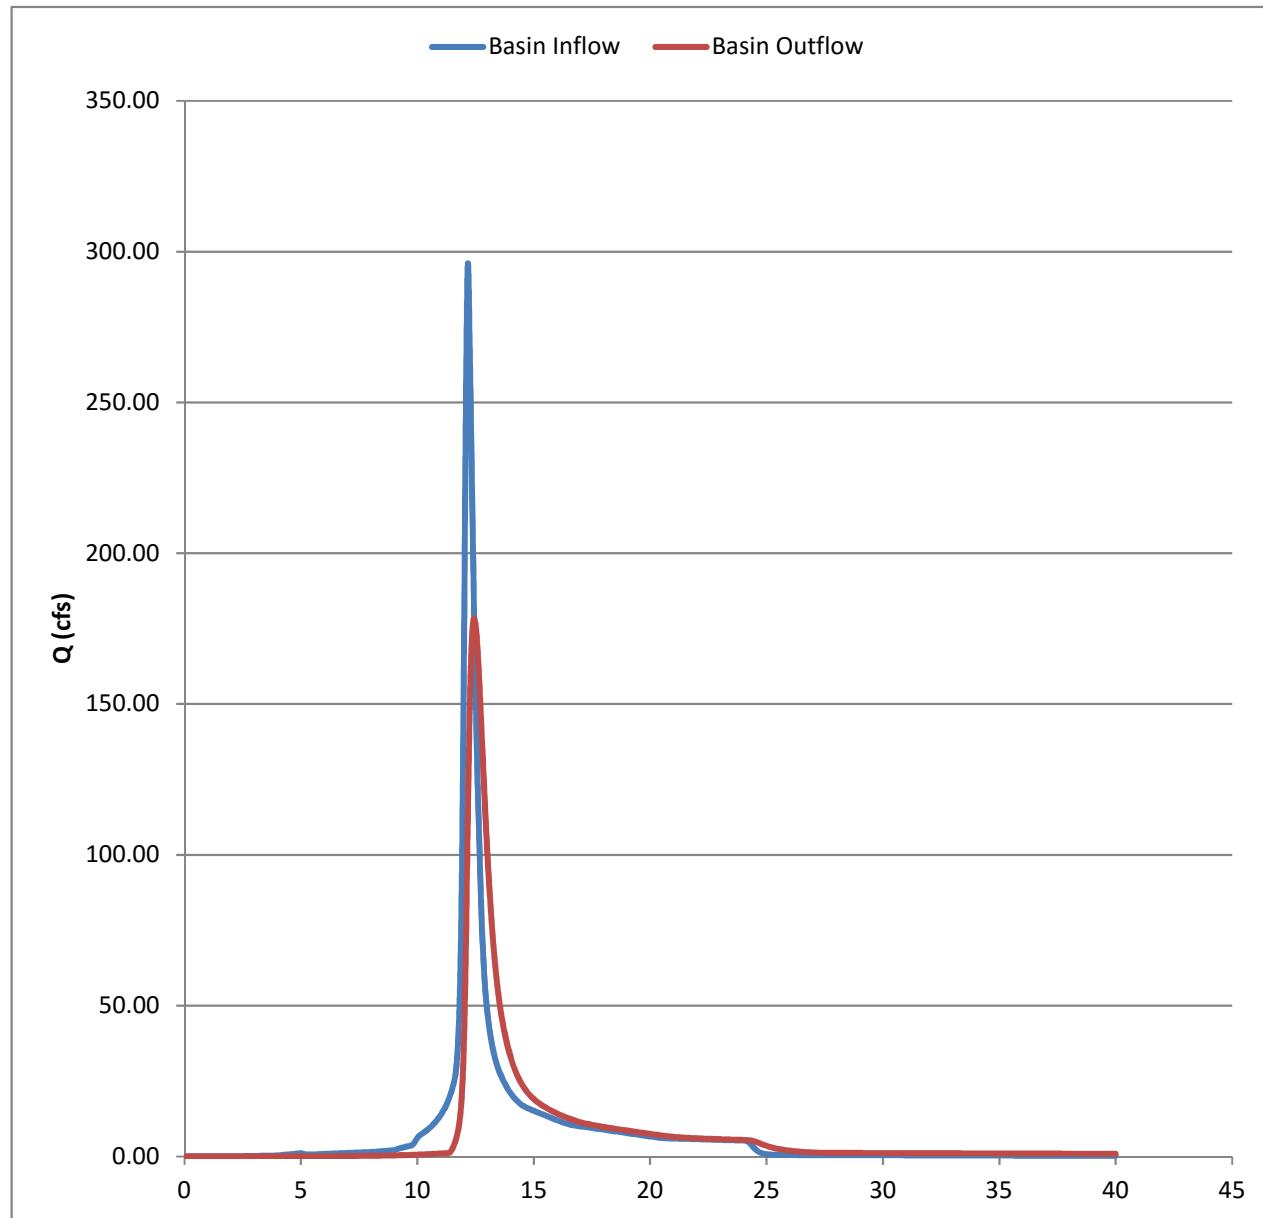

## Cabelas Basin

Hydrograph Type	=	Reservoir	Peak Discharge =	108.61
Storm Frequency	=	100 yrs	Time to Peak =	12:10 hrs
Time Interval	=	6 min	Max Elevation =	871.84
			Max Storage =	114,387 Ft <sup>3</sup>
			Date =	6/2/2016


Notes:

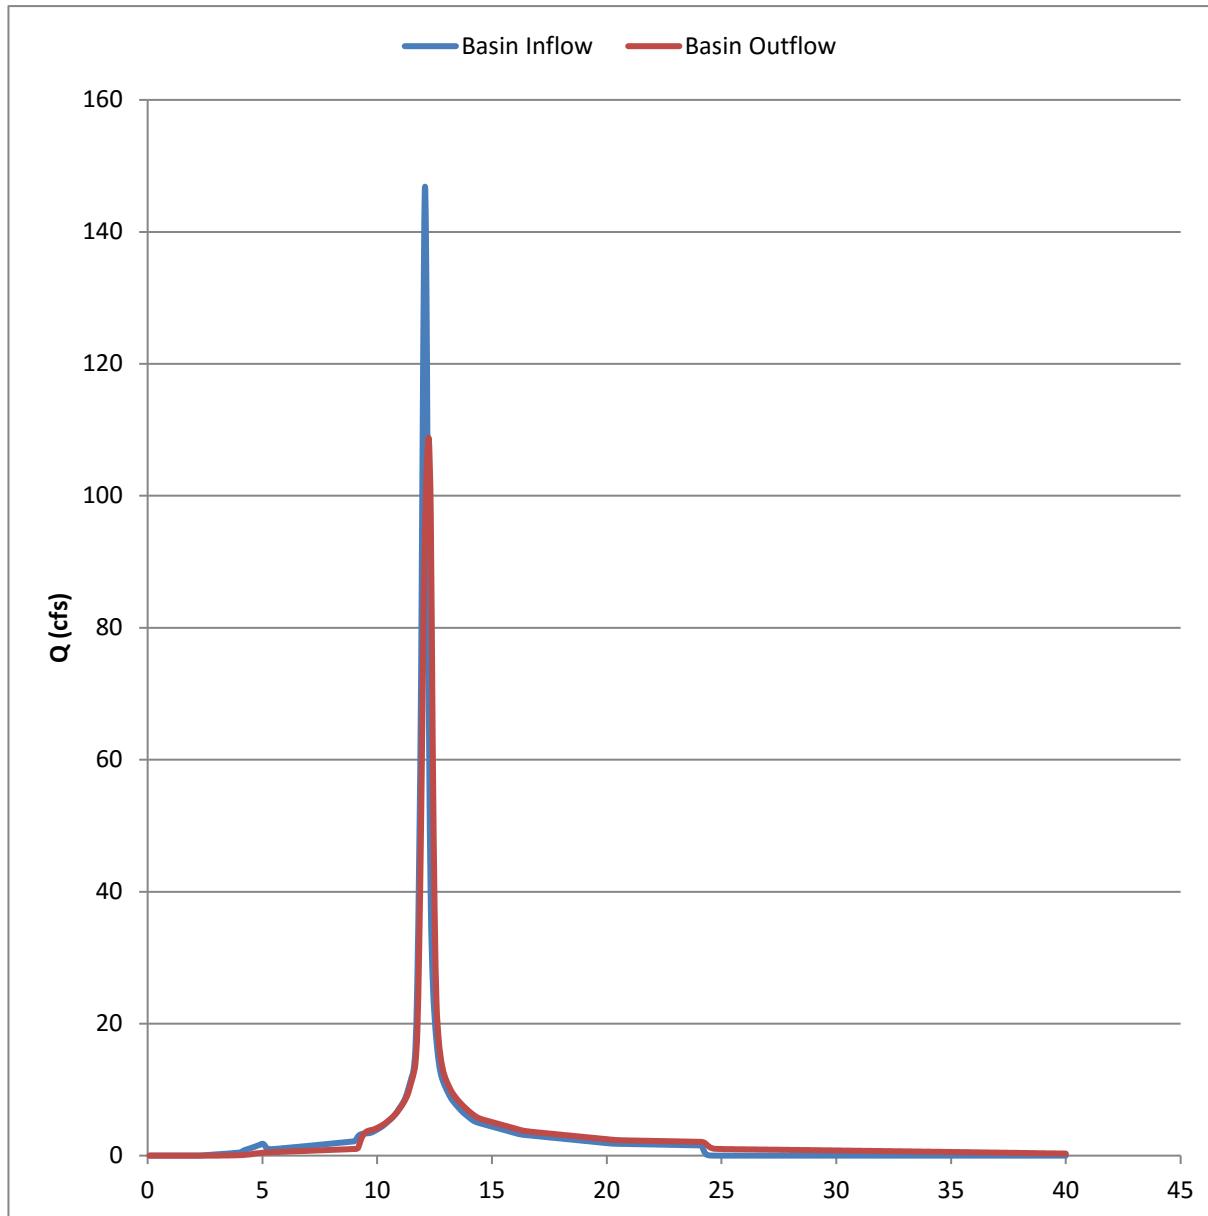

## Existing Pond

Hydrograph Type	=	Reservoir	Peak Discharge =	42.67
Storm Frequency	=	100 yrs	Time to Peak =	12:25 hrs
Time Interval	=	6 min	Max Elevation =	866.53
			Max Storage =	49,766 Ft <sup>3</sup>
			Date =	6/2/2016


Notes:

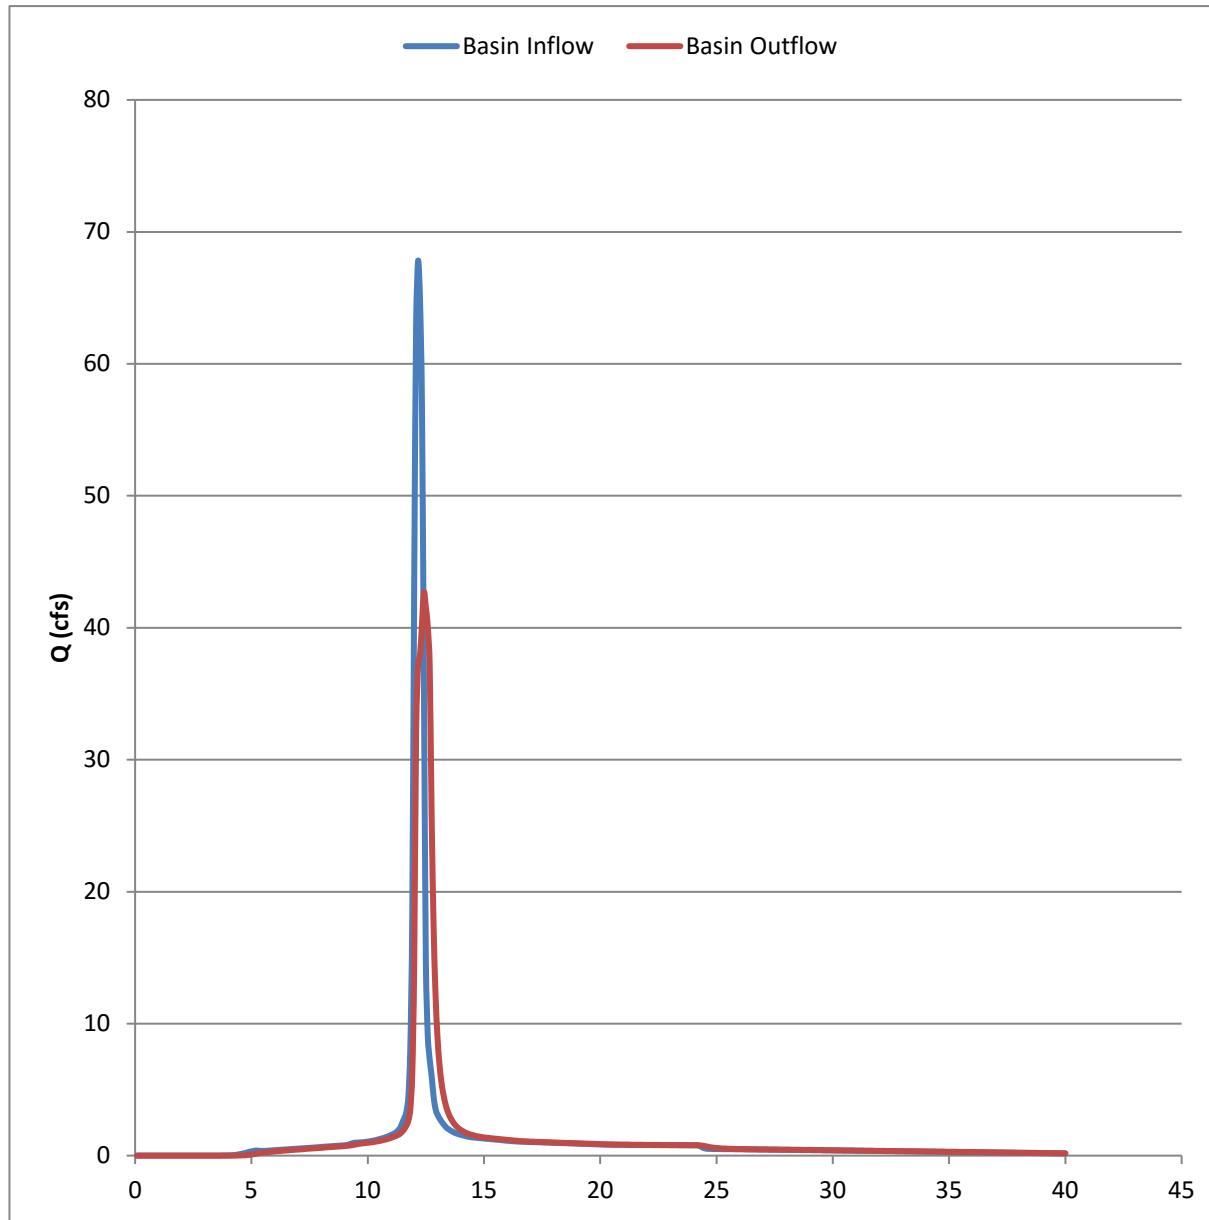

## Primary Basin

Hydrograph Type	=	Reservoir	Peak Discharge =	208.15
Storm Frequency	=	100 yrs	Time to Peak =	12:25 hrs
Time Interval	=	6 min	Max Elevation =	860.11
			Max Storage =	377,912.3 Ft <sup>3</sup>
			Date =	9/21/2016

Notes:

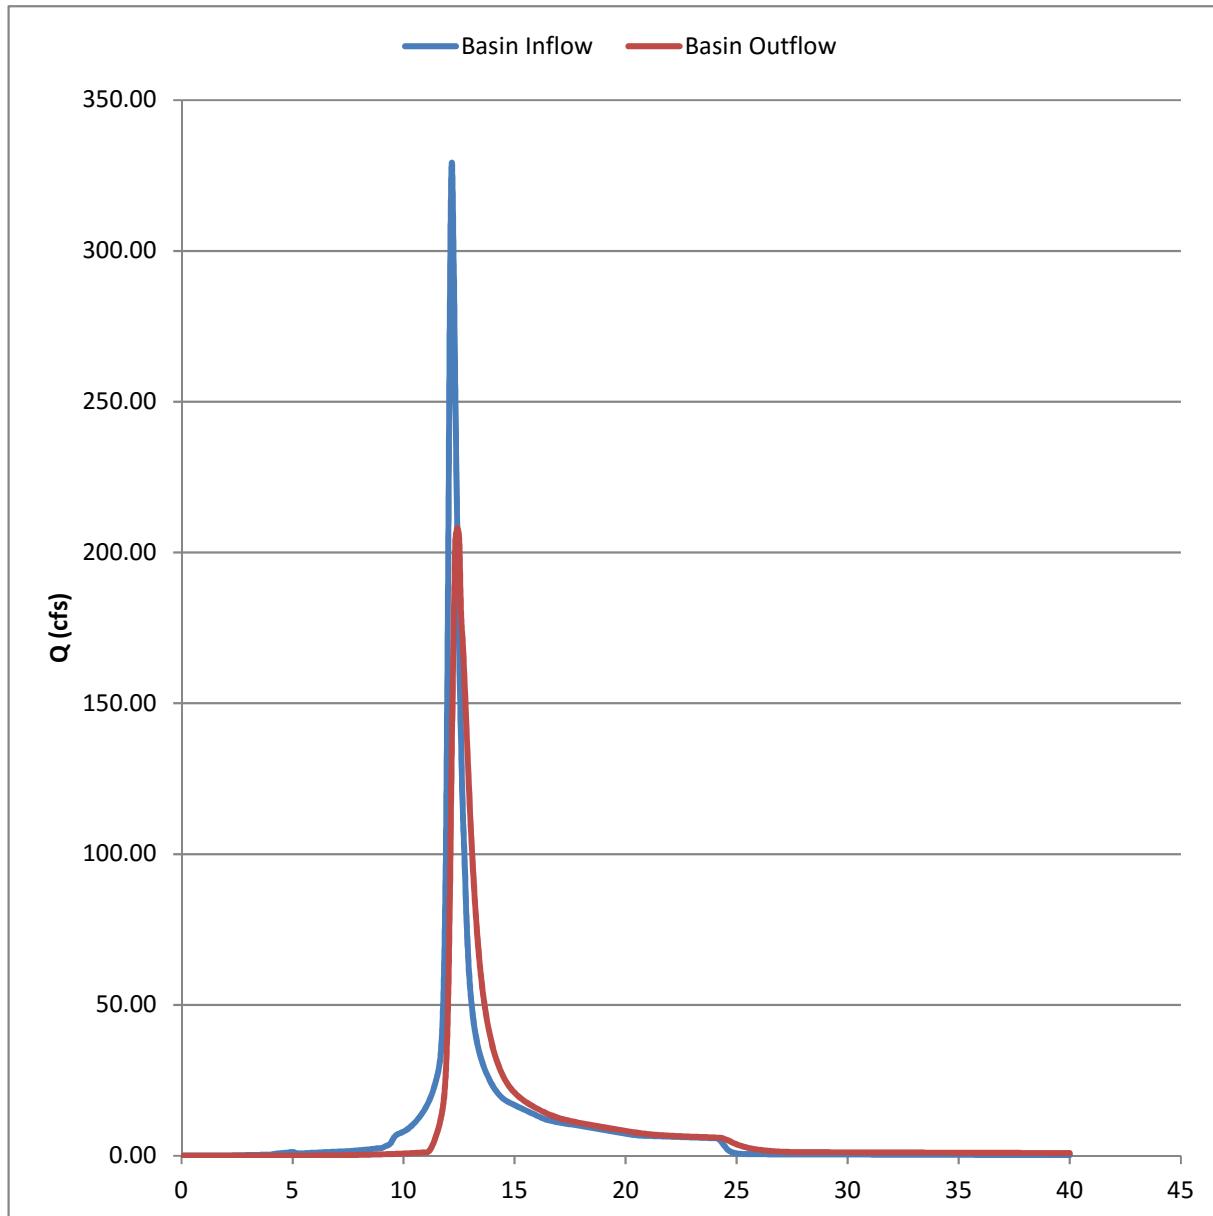

# HY-8 Culvert Analysis Report

## Crossing Discharge Data

Discharge Selection Method: Specify Minimum, Design, and Maximum Flow

Minimum Flow: 20.05 cfs

Design Flow: 208.15 cfs (100 yr Basin Outflow)


Maximum Flow: 329.42 cfs (100 yr Basin Inflow)

**Table 1 - Summary of Culvert Flows at Crossing: Keefe Property**

Headwater Elevation (ft)	Total Discharge (cfs)	4'x8' Box Discharge (cfs)	Roadway Discharge (cfs)	Iterations
853.18	20.05	20.05	0.00	1
854.04	50.99	50.99	0.00	1
854.71	81.92	81.92	0.00	1
855.29	112.86	112.86	0.00	1
855.83	143.80	143.80	0.00	1
856.36	174.74	174.74	0.00	1
856.91	205.67	205.67	0.00	1
857.02	208.15	208.15	0.00	1
858.24	267.55	267.55	0.00	1
859.40	298.48	298.48	0.00	1
860.64	329.42	329.42	0.00	1
862.54	373.32	373.32	0.00	Overtopping

**Rating Curve Plot for Crossing: Keefe Property**

**Total Rating Curve**  
Crossing: Keefe Property

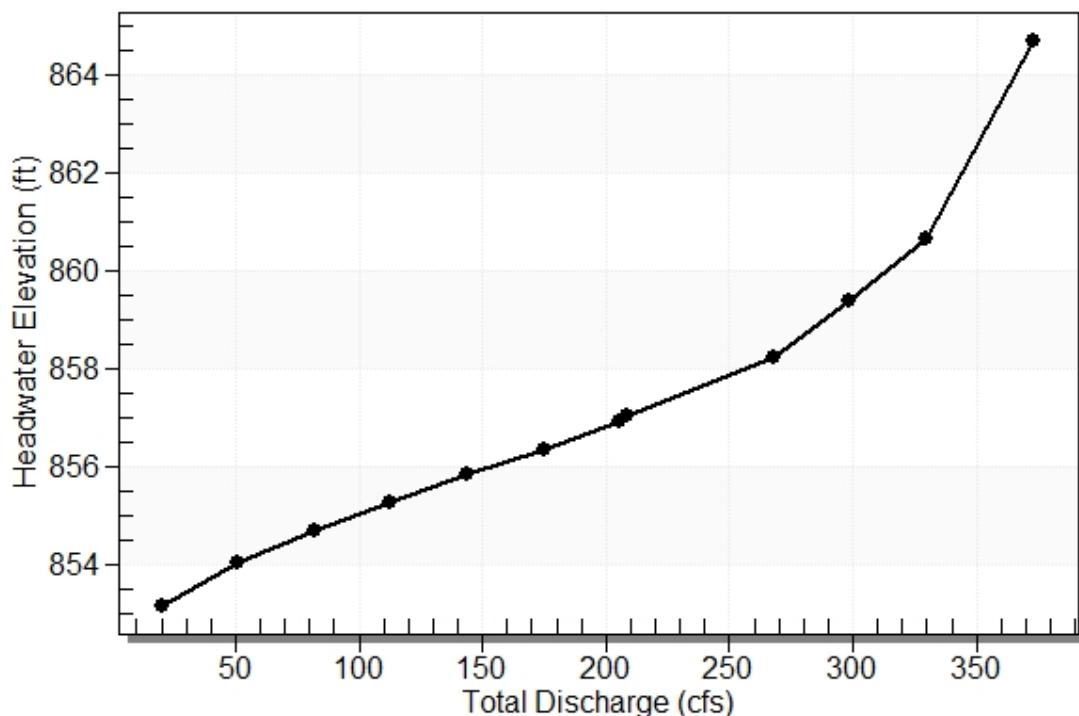

**Table 2 - Culvert Summary Table: 4'x8' Box**

Total Discharge (cfs)	Culvert Discharge (cfs)	Headwater Elevation (ft)	Inlet Control Depth (ft)	Outlet Control Depth (ft)	Flow Type	Normal Depth (ft)	Critical Depth (ft)	Outlet Depth (ft)	Tailwater Depth (ft)	Outlet Velocity (ft/s)	Tailwater Velocity (ft/s)
20.05	20.05	853.18	0.993	0.0*	1-JS1t	0.565	0.580	0.650	0.650	3.853	7.706
50.99	50.99	854.04	1.850	0.0*	1-JS1t	1.055	1.081	1.233	1.233	5.169	10.338
81.92	81.92	854.71	2.519	0.643	1-JS1t	1.448	1.482	1.737	1.737	5.897	11.794
112.86	112.86	855.29	3.103	1.370	1-JS1t	1.799	1.835	2.207	2.207	6.393	12.786
143.80	143.80	855.83	3.644	2.160	1-S2n	2.126	2.157	2.126	2.658	8.456	13.524
174.74	174.74	856.36	4.174	3.019	5-S2n	2.437	2.456	2.437	3.098	8.962	14.103
205.67	205.67	856.91	4.718	3.952	5-S2n	2.737	2.738	2.737	3.529	9.392	14.572
208.15	208.15	857.02	4.762	4.832	7-M1t	2.761	2.760	3.563	3.563	7.303	14.606
267.55	267.55	858.24	5.924	6.046	4-FFF	3.313	3.263	4.000	4.374	8.361	15.293
298.48	298.48	859.40	6.616	7.209	4-FFF	3.592	3.510	4.000	4.790	9.328	15.578
329.42	329.42	860.64	7.379	8.451	4-FFF	4.000	3.748	4.000	5.204	10.294	15.826

\* Full Flow Headwater elevation is below inlet invert.

\*\*\*\*\*

**Straight Culvert**


Inlet Elevation (invert): 852.19 ft, Outlet Elevation (invert): 850.81 ft

Culvert Length: 461.00 ft, Culvert Slope: 0.0030

\*\*\*\*\*

**Water Surface Profile Plot for Culvert: 4'x8' Box**

**Crossing - Keefe Property, Design Discharge - 208.2 cfs**  
**Culvert - 4'x8' Box, Culvert Discharge - 208.2 cfs**

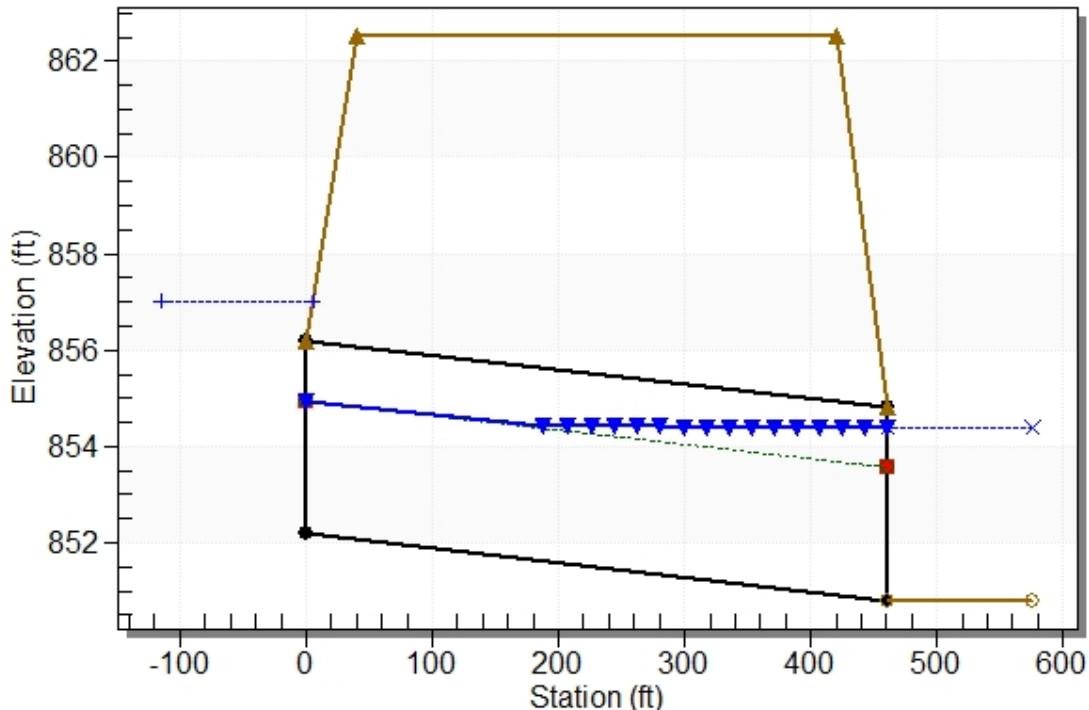

### **Site Data - 4'x8' Box**

Site Data Option: Culvert Invert Data

Inlet Station: 0.00 ft

Inlet Elevation: 852.19 ft

Outlet Station: 461.00 ft

Outlet Elevation: 850.81 ft

Number of Barrels: 1

### **Culvert Data Summary - 4'x8' Box**

Barrel Shape: Concrete Box

Barrel Span: 8.00 ft

Barrel Rise: 4.00 ft

Barrel Material: Concrete

Embedment: 0.00 in

Barrel Manning's n: 0.0120

Culvert Type: Straight

Inlet Configuration: Square Edge (90°) Headwall

Inlet Depression: NONE

### **Tailwater Channel Data - Keefe Property**

Tailwater Channel Option: Rectangular Channel

Bottom Width: 4.00 ft

Channel Slope: 0.0100

Channel Manning's n: 0.0120

Channel Invert Elevation: 850.81 ft

### **Roadway Data for Crossing: Keefe Property**

Roadway Profile Shape: Constant Roadway Elevation

Crest Length: 60.00 ft

Crest Elevation: 862.54 ft

Roadway Surface: Paved

Roadway Top Width: 380.00 ft